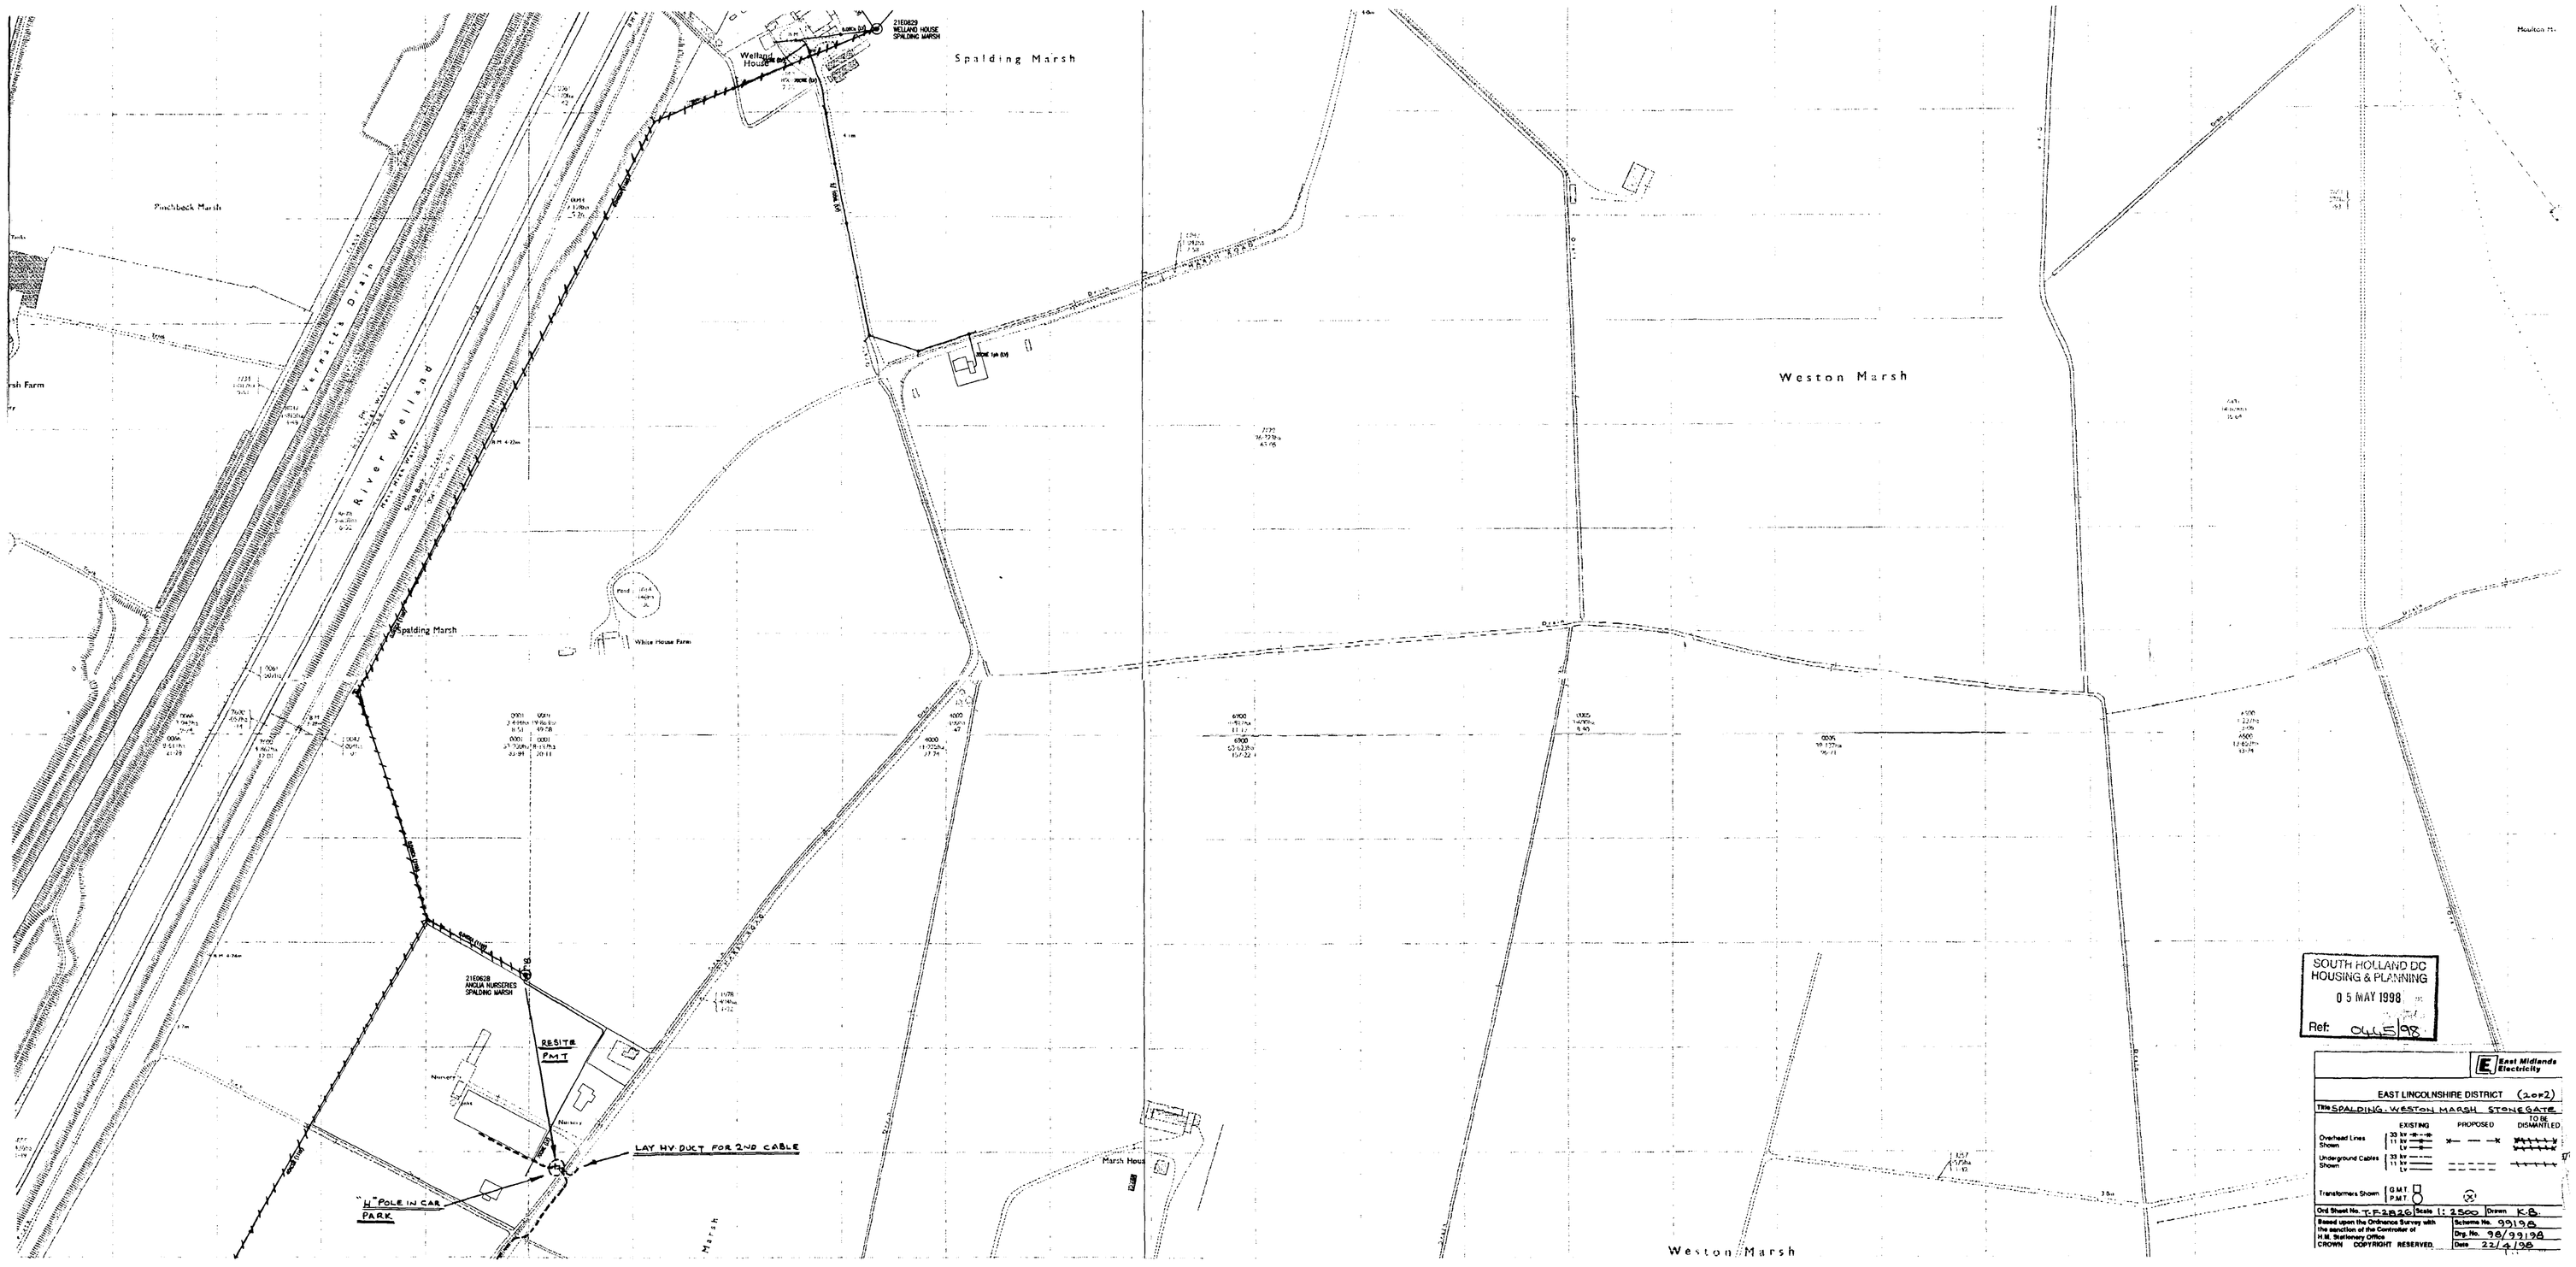

DETERMINED PLAN



Spalding Marsh
RESITE PMT
3x70 XLPE
ACCESS - JUNE/JULY
3x70 XLPE
3x50 ACSR
RESERVICE U/G
RESITE PMT.
Weston Marsh Farm
3x50 ACSR
Spalding Marsh
3x70 XLPE
SEE MR. HAY RE. CABLE ROUTE
SEE FARMER RE. CABLE ROUTE AND NEW PMT
RESITE PMT
3x50 ACSR
RESITE PMT.
KEEP ACCESS CLEAR
A TO B:-
LAY DUCT FOR HV CABLE.
SOUTH HOLLAND DC
HOUSING & PLANNING
05 MAY 1998
Ref: 0445/98
East Midlands Electricity
EAST LINCOLNSHIRE DISTRICT (1 of 2)
Title SPALDING, WESTON MARSH STONEGATE.
EXISTING
PROPOSED
TO BE DISMANTLED
Overhead Lines Shown
Underground Cables Shown
Transformers Shown
Ord Sheet No. TF2826
Scale 1:2500
Drawn K.B.
Based upon the Ordnance Survey with the sanction of the Controller of H.M. Stationery Office
CROWN COPYRIGHT RESERVED.
Scheme No. 99198
Drg. No. 98/99198
Date 22/4/98
DETERMINED PLAN