


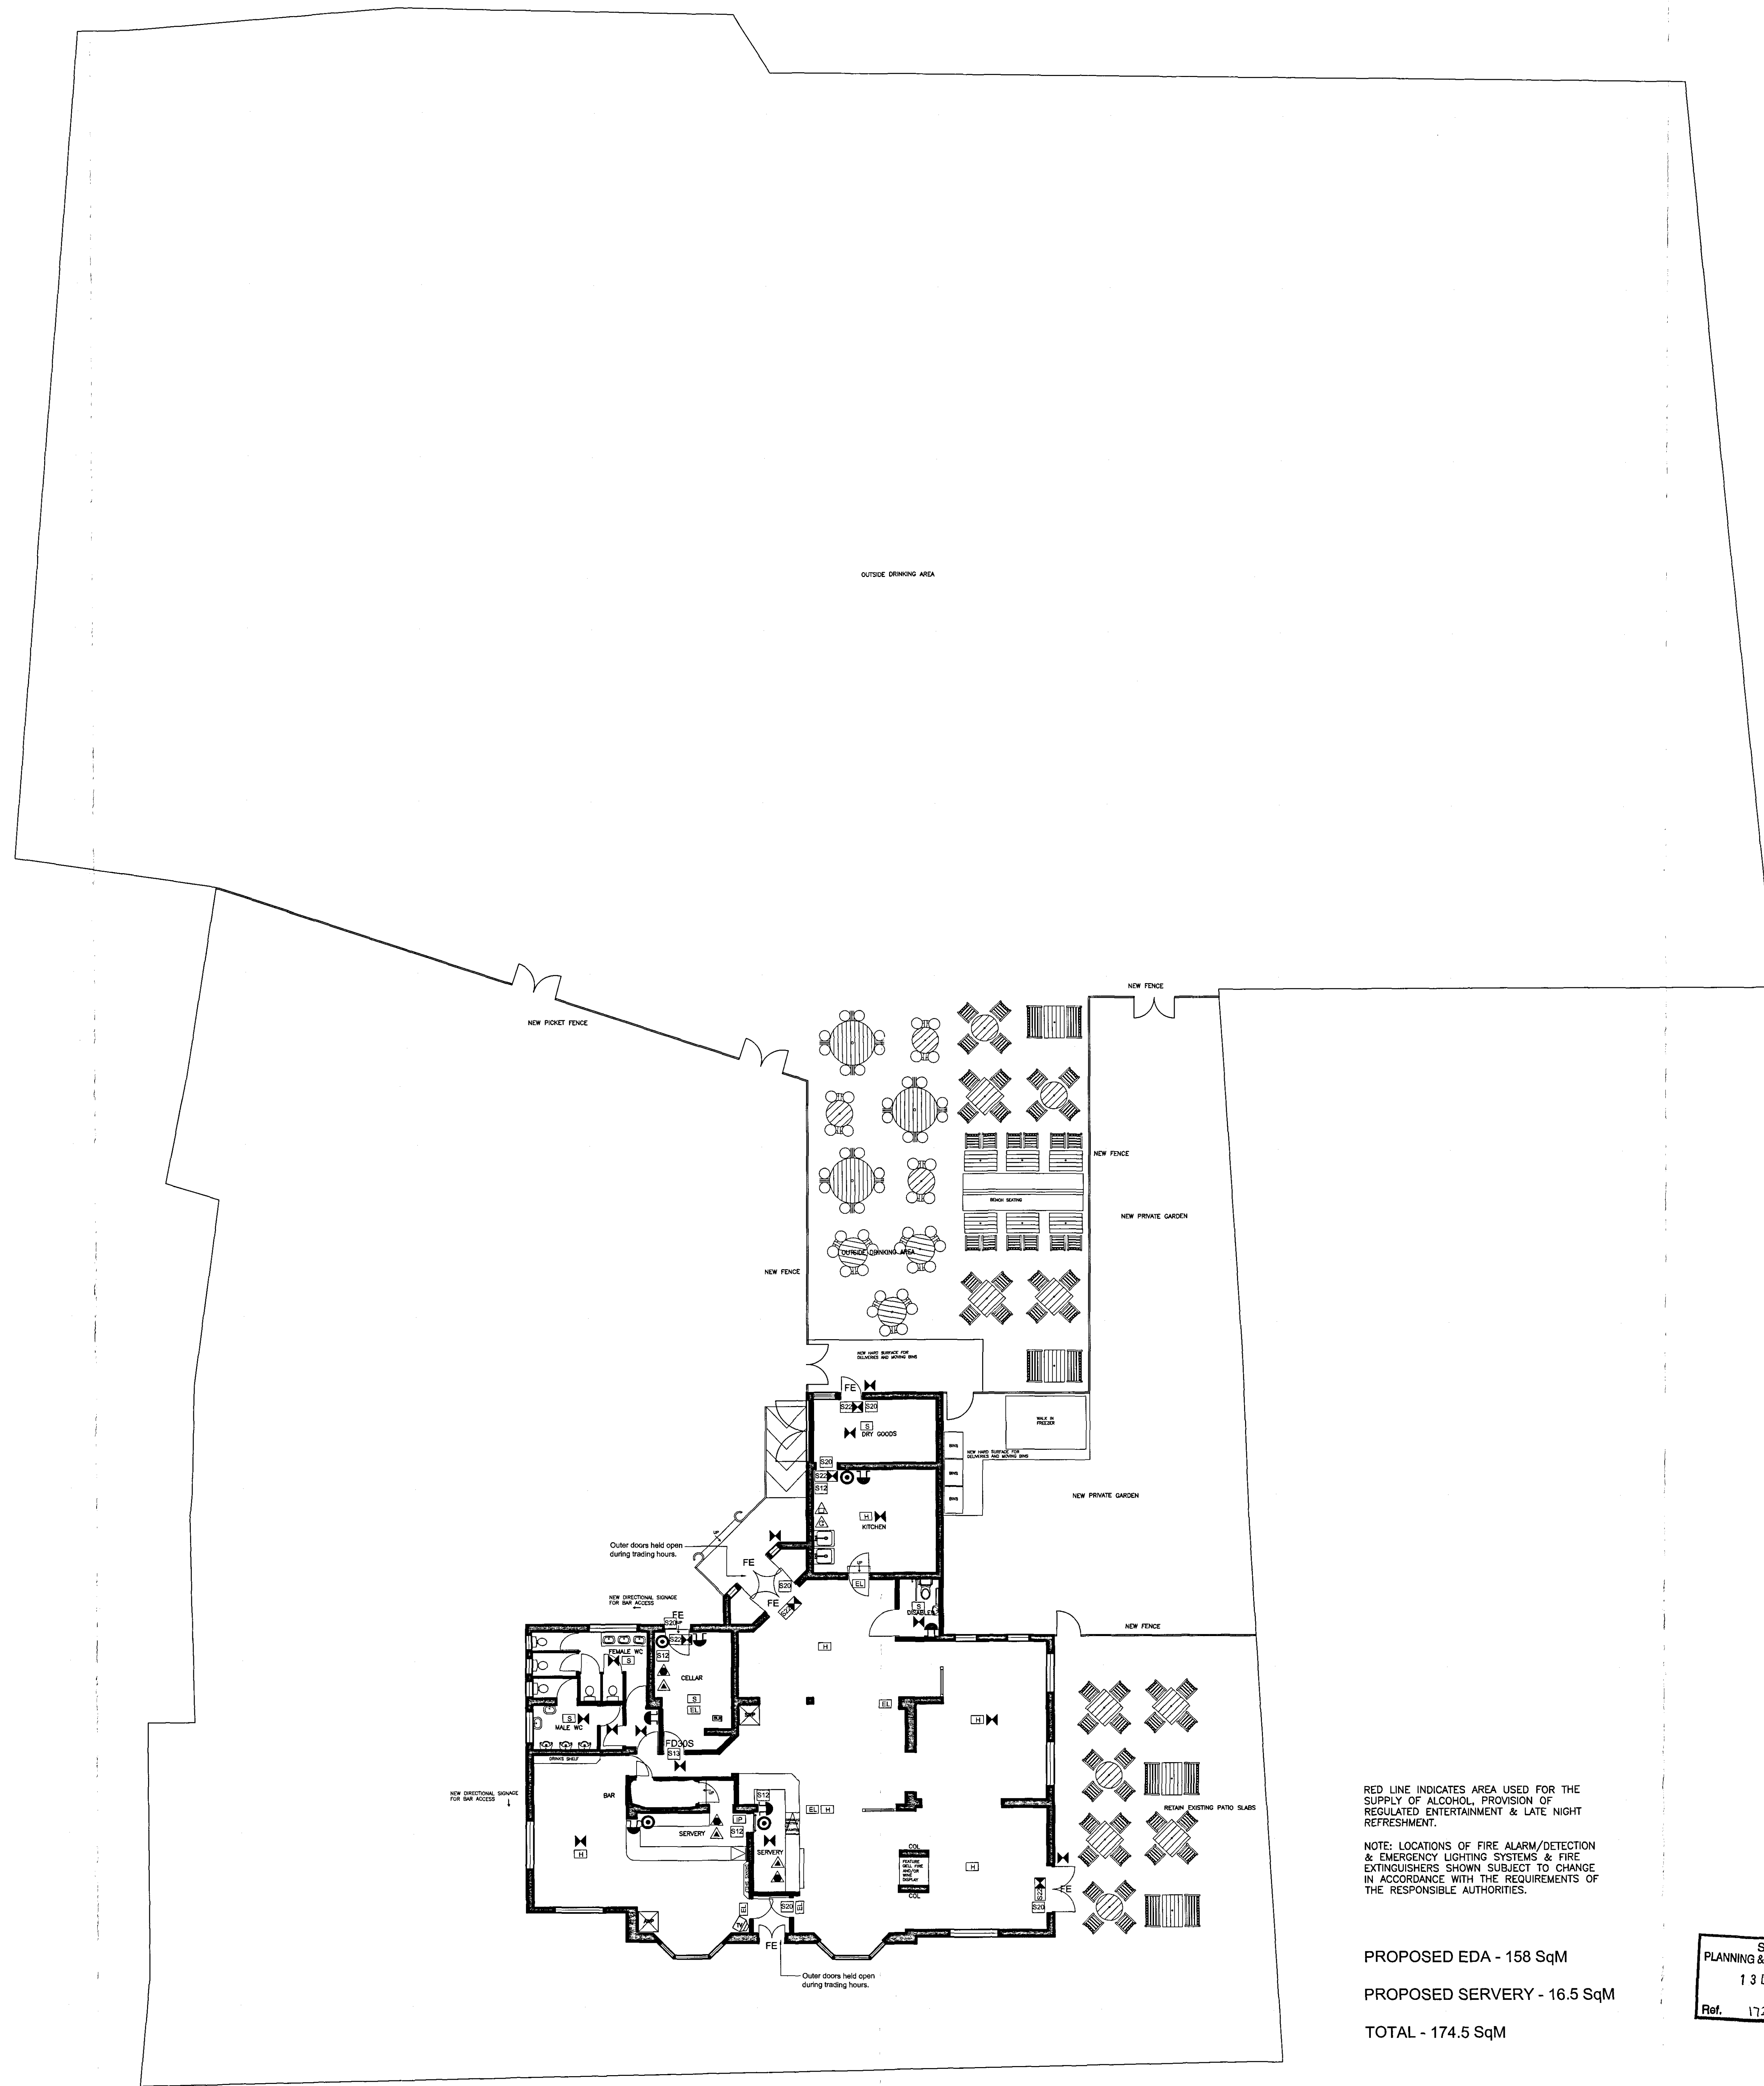

RED LINE INDICATES AREA USED FOR THE SUPPLY OF ALCOHOL, PROVISION OF REGULATED ENTERTAINMENT & LATE NIGHT REFRESHMENT.

NOTE: LOCATIONS OF FIRE ALARM/DETECTION & EMERGENCY LIGHTING SYSTEMS & FIRE EXTINGUISHERS SHOWN SUBJECT TO CHANGE IN ACCORDANCE WITH THE REQUIREMENTS OF THE RESPONSIBLE AUTHORITIES.

PROPOSED EDA - 158 SqM

PROPOSED SERVERY - 16.5 SqM

TOTAL - 174.5 SqM

SHDC
PLANNING & DEVELOPMENT
13 DEC 2006
Ref. 1722/06

- SYMBOL KEY:**
- CONSTRUCTION**
- FD30S Fire resisting door, 30 minutes minimum, with self-closing devices
- FD60S Fire resisting door, minimum 60 minutes, with self-closing devices
- FE Fire exit
- FIRE EXTINGUISHERS**
(UNLESS SIZE UNLESS OTHERWISE STATED)
- Water type, 9 litres minimum
- Foam type, 9 litres minimum
- Dry powder type, 4kg minimum
- Fire blankets, 2m x 1m minimum
- Carbon dioxide type, 2.25kg minimum
- FIRE WARNING SYSTEM**
- Fire alarm call point
- Audible warning device
- Automatic fire detection - smoke
- Automatic fire detection - heat
- Fire alarm indicator panel
- EMERGENCY LIGHTING**
- Emergency lighting unit
- Existing emergency lighting unit
- Illuminated exit sign boxes (ESB indicates isolated exit sign)
- NOTICES**
- Staff fire notice
- FIRE EXIT KEEP CLEAR notice
- FIRE DOOR KEEP SHUT notice

DETERMINED
PLAN

DO NOT SCALE. WRITTEN DIMENSIONS TO BE USED IN PREFERENCE TO SCALED DIMENSIONS. ALL DIMENSIONS TO BE CHECKED ON SITE BY CONTRACTOR & ALL DISCREPANCIES TO BE REPORTED TO HERON DESIGN.	
JOB TITLE	
THE CARTERS ARMS 97 HIGH ROAD, WESTON LINCOLNSHIRE, PE12 6RA (PROPERTY ID: 017044/58)	
DRAWING TITLE	
GROUND FLOOR LAYOUT LICENSING APPLICATION	
SCALE 1:100 @ A0	DRAWING No 2610/L1
DATE 04.09.06	
DRAWN BY RGC	
	
QUEEN STREET, NORMANTON, WEST YORKSHIRE, WF6 1AB	
T: 01924 893022 F: 01924 896078 E: innovation@herondesign.co.uk www.herondesign.co.uk	