**General Notes**

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other that that for which it is issued without written permission from Messrs Status Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architects so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

Please note this drawing is not a conveyance drawing.

Proposed on-site soakaways to be maintained by the owner for the life duration of the property.


This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Planning and Building Regulations approvals. This drawing must not be used as a contract document alone. The works will not be supervised or inspected by Status Design unless specifically contracted to do so. It is the client or their agent's responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract, etc.

All materials to be new unless stated otherwise and all components and materials, etc. to be used, fitted and installed, etc. in strict accordance with manufacturers' instructions and relevant Code of Practise. Materials should conform to appropriate British Standard specification or BBA Certificate or European Code equivalent.

The Employer/Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety Legislation for Building Sites and Work Places. The Employer/Client is advised that should the works need to comply with the Construction Design and Management Regulations 1994 (CDM) and Health and Safety at Work, etc., Act 1974 (HSW Act) an independent Planning Supervisor will be required, whom should be supplied with a set of all relevent drawings, etc.

The works shall comprise of all that shown on the drawings and information, etc. Works that may not specifically be shown but may be reasonably inferred as necessary to carry out the works shall be deemed to be included.

These notes relate to this drawing and all associated drawings.

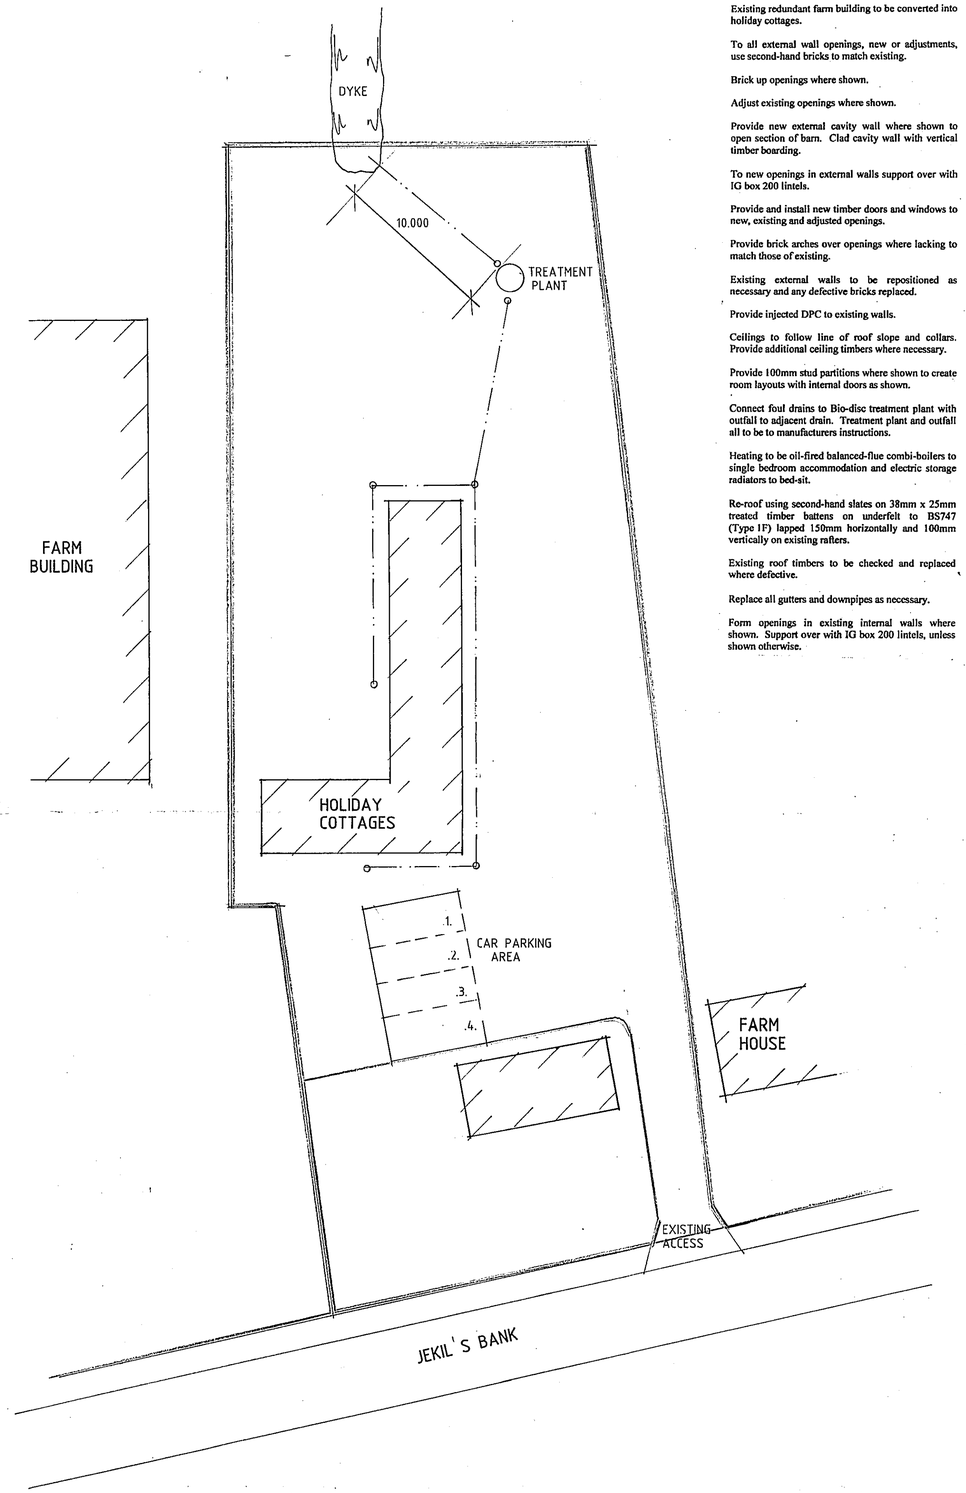


**External Lighting Fixed to the Building**
External lights include lights in porches but not lights in garages and carports.

External lights should be made to enable effective control and/or the use of efficient lamps as follows:

a) Automatically extinguish when there is enough daylight and when not required at night.

b) Have sockets that can only be used with lamps having an efficiency greater than 40 lumens per circuit watt.

**Oil Tank**
To be sited a minimum 1800mm from any building and a minimum 760mm from any boundary. Tanks to be bunded to give 110% capacity of the largest tank they contain or the tank should be double skinned

**Dry Lining**
Dry line existing solid external walls with Celotex TUFF-R™ Zero GA3000Z system internally all in accordance with manufacturers specification.

**Sewage Treatment Plant**
A suitable notice in regard to the package treatment work should be provided within the property, it is suggested that this is contained within a property log book. An example of the wording could be, 'The foul drainage from this property discharges to a package treatment works. Maintenance is required (insert frequency) and should be carried out by the owner in accordance with manufacturer's instructions. The owner is legally responsible to ensure that the system does not cause pollution, a health hazard or a nuisance'.

**Electrical Work**
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a person competent to do so. Prior to completion of the works the council must be satisfied that either:-
a) an electrical installation certificate issued under a competent person's scheme has been issued
or
b) an appropriate electrical installation certificate has been issued for the work, and that it has been signed by a person competent to do so.

**Wall Construction 285mm Cavity**
285mm cavity walls to consist of: -
100mm face brickwork (see site plan for details), 85mm cavity to be filled with Crown Dritherm 32, 100mm internal skin of Tarmac Durox Supabloc or similar approved to give 0.29 U value.
Cavity wall ties to be stainless steel type spaced 900mm horizontally and 450mm vertically to BS1243, 1978. Internal blockwork walls to receive 10mm sand/cement render and skim finish. Robust details in accordance with T50, 2001.

Brickwork below d.p.c. to be F.L. quality

Outlets from balanced flue boilers to be at least 300mm from any openings.

Provide area for provision of solid waste storage (rubbish bins).

All external lintels to be insulated type.

All external joinery to be fully draught proofed.

Loft hatch to be draught sealed and latched shut.

Insulation in roof space to meet with insulation in external cavity walls to prevent cold bridging.

To all domestic floors to external perimeter walls provide 25mm thick insulation dressed up walls to prevent cold bridging.

Seal all openings and joints to perimeter walls.

All doors, windows and any loft hatches to be effectively sealed and draught proofed.

Provide a fibrous separating member between floor screed and insulation and provide chicken wire between insulation and screed.

Existing redundant farm building to be converted into holiday cottages.

To all external wall openings, new or adjustments, use second-hand bricks to match existing.

Brick up openings where shown.

Adjust existing openings where shown.

Provide new external cavity wall where shown to open section of barn. Clad cavity wall with vertical timber boarding.

To new openings in external walls support over with IG box 200 lintels.

Provide and install new timber doors and windows to new, existing and adjusted openings.

Provide brick arches over openings where lacking to match those of existing.

Existing external walls to be repositioned as necessary and any defective bricks replaced.

Provide injected DPC to existing walls.

Ceilings to follow line of roof slope and collars. Provide additional ceiling timbers where necessary.

Provide 100mm stud partitions where shown to create room layouts with internal doors as shown.

Connect foul drains to Bio-disc treatment plant with outfall to adjacent drain. Treatment plant and outfall all to be to manufacturers instructions.

Heating to be oil-fired balanced-flue combi-boilers to single bedroom accommodation and electric storage radiators to bed-sit.

Re-roof using second-hand slates on 38mm x 25mm treated timber battens on underfelt to BS747 (Type 1F) lapped 150mm horizontally and 100mm vertically on existing rafters.

Existing roof timbers to be checked and replaced where defective.

Replace all gutters and downpipes as necessary.

Form openings in existing internal walls where shown. Support over with IG box 200 lintels, unless shown otherwise.

Form new internal separate cavity wall where shown to conform to sound specification E-WM-1.

Renew ground floors where necessary.

Where floors in good order paint with 2 no. coats of Synthaprufe and lay 60mm Celotex and 19mm water-resistant Weyroc decking.

External walls to be dry-lined.

Make good to all disturbed and affected areas.

**Roof Ventilation to Sloping Ceiling**
At eaves provide proprietary ventilation equivalent to a 25mm continuous gap along eaves. At ridge provide proprietary ventilation equivalent to a 5mm continuous gap.

**Kitchen Ventilation**
Provide proprietary mechanical extract ventilation unit capable of extracting 60 lt/sec. Alternatively provide proprietary cooker hood capable of extracting 30 lt/sec.

**Bathroom/En-suite Ventilation**
Provide proprietary mechanical extract ventilation unit capable of extracting 15 lt/sec. System to offer intermittent operation.

**Hot Water Storage**
Provide system approved by BBA and installed by BBA approved installer. System to be vented and insulated in accordance with BS5615 1985. Provide thermostatic control.

**Heating System**
Provide room thermostat or thermostatic radiator valves or similar approved to control the output from the heating system.

**Insulated Pipes and Ducts**
All pipes, which do not contribute to the heating of the building, will be insulated to BS5422 1977.

**Safety Glazing**
Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

**Lintels**
All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c. To be confirmed on site with Building Control Surveyor

Opening at eaves level to be L1/E lintels by I.G. or similar approved.

**Sub-structure Walling**
100 mm Class A dense concrete blocks. Bitumen felt d.p.c. to external walls 150mm above ground level. Weak mix infill to base of cavities to terminate 225mm below lowest d.p.c. level.

**Foundations**
As indicated on plan provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widen foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be ST3 grade unless noted otherwise. Proximity of existing and proposed trees are to be taken into account in accordance with N.H.B.C. chapter 4 when determining foundation depth.

I.G. Type L1/S75 lintels to cavity walls and I.G. type internal lintels to 100mm internal walls unless stated otherwise. . To be confirmed on site with Building Control Surveyor.

Provide a firm level approach to front entrance of minimum width 900mm. Gradient of approach to be no steeper than 1:20. At entrance to building threshold to be maximum 15mm high.

External access door that serves as access to ground floor WC to have a minimum clear opening width of 775mm.

Ensure minimum 900mm corridor width, access to ground floor WC with no obstructions (radiators, etc.) to corridor area adjacent doors

Sockets, light switches, TV points, doorbells to habitable rooms to be positioned between 450mm and 1200mm above floor level.

**Smoke Detection**
Provide mains operated self-contained smoke alarms to BS5446 Part 1 in accordance with Approved Document B1.

**Rainwater Goods**
PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

**Wall Construction**
275mm cavity walls to consist of:
100mm face brickwork (see site plan for details), 75mm cavity to be filled with Crown Dritherm full fill insulation in accordance with BBA Certificate No. 86/1678 or similar approved, 100mm internal skin of Celcon standard blocks or similar approved to give 0.35 U/value. Cavity walls ties to be stainless steel type spaced 900mm horizontally and 450mm vertically to BS1243, 1978. Internal blockwork walls to receive 10mm sand/cement render and skim finish. Robust details in accordance with T50, 2001.

**Habitable Room Trickle Ventilation**
Provide proprietary trickle ventilators to head of windows giving a total opening area of not less than 8000mm²

**Kitchen/Utility/Bathroom/WC Trickle Ventilation**
Provide proprietary trickle ventilators to head of window giving a total opening area of not less than 4000mm²

**Roof Insulation**
To roof spaces provide proprietary 300mm thick fibreglass insulation laid as 100mm between joists and 200mm across joists or equivalent to give 0.16 U/value. Ensure a gap of 50mm between roof underfelt and quilt at all times.

**Roof Insulation to Sloping Ceiling**
To ceiling slope provide 50mm Celotex between rafters and 75mm Celotex below rafters. Ensure a gap of 50mm between roof underfelt and insulation at all times.

**Protection to Underground Pipes**
Where pipes are not under road and have less than 600mm cover concrete paving slabs should be laid as bridging above the pipes on minimum 75mm pea gravel. If flexible pipes are under a road and have less than 900mm cover reinforced concrete bridging should be used instead of paving slabs. Provide compressible material below slab/concrete.

**Foul Water Drainage**
Underground drainage to be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Under building drains to be encased in 150mm pea gravel with lintel over pipes at wall abutments. Where drain passes through wall, provide suitable protection to prevent gas ingress to building. 110mm diameter soil and vent pipe to extend 900mm above window head and to terminate in balloon finial. Soil and vent pipe to be fitted with access plate at base. Provide suitably sized wastes from all appliances (in accordance with Approved Document H) complete with minimum 75mm deep sealed traps and rodding eye access points at every direction change. All above ground drainage to BS5582 and all underground drainage to BS8301. Provide seal plates both sides of pipe entry to avoid vermin entry.

**Inspection Chamber Construction**
Proprietary polypropylene inspection chambers bedded on 150mm concrete. Form protective 255mm thick concrete collar around head of inspection chamber with 300mm projection from cover. Covers to be Grade C light duty unless inspection chambers are in driveways where Grade B medium duty covers are to be used.

**Boiler**
Provide balanced flue type oil fired boiler of required rating in position indicated on drawing to be either a wall hung type or free standing on 125mm high concrete hearth above oversite. Boiler to have protective guard cover and to be minimum 600mm from any opening into the building. Read in conjunction with Approved Document J1/2/3. At completion of works commissioning of heating system to be provided to the local authority Building Control by a competent Corgi registered person. Boiler to have a Sedbuk rating of 86%

**Header Tank Support**
Water tank in roof space to be supported on bearers to spread the load to BS5268 Part 3 1985.

**Ceilings**
To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard of 10kg/m² or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

Provide area within main driveway of hard surfacing (block paving, tarmac or similar) of adequate size to enable wheelchair access from parked vehicle direct to main access of dwelling. Footpath minimum 900mm wide to be directly linked to hard surfacing driveway.

Minimum width of corridors and passageways for a range of doorway widths

| Doorway clear opening width (mm) | Corridor/Passageway width(mm) |
|---|---|
| 750 or wider | 900 (when approached head-on) |
| 750 | 1200 (When approached not head-on) |
| 775 | 1050 (when approached not head-on) |
| 800 | 900 (when approached not head-on) |

All windows to give minimum 1/20th of floor area as ventilation and to be double-glazed.

**Glazing**
All windows and doors to be double-glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved, efficiency of 0.05.

**Commissioning of Heating and HWS Systems**
A competent person, i.e. the main contractor or sub-contractor shall supply a Certificate of Satisfactory Compliance with Building Regulations Part L. A copy of which shall be made available to both the client and the Building Control body.

A suitable set of operating and maintenance instructions are to be made available to the client to explain to the householders how to operate the systems so that they can perform efficiently and what routine maintenance is advisable for the purpose of the conservation of fuel and power.

**Internal Lighting**
Provide energy efficient lights that only take lamps having a luminous efficiency greater than 40 lumens per circuit watt. Examples of lamps are fluorescent tubes and compact fluorescent lamps (note GLS tungsten lamps with bayonet cap or Edison screw bases).

Method of determining number of locations:

Provide energy efficient lights of one per 25m² of floor area or one per four fittings whichever is the largest.

Excludes garages, lofts and outhouses.

THIS DRG. TO BE READ IN CONJUNCTION WITH SD06-034/1, SD06-034/3

Note: site boundary amended with email of 16/1/07 DAG.

SHDC
PLANNING & DEVELOPMENT
11 JAN 2007
Ref. 0094/07

DETERMINED PLAN

Status DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED CONVERSION OF REDUNDANT FARM BUILDING TO HOLIDAY COTTAGES AT STENNETTS FARM, JEKIL'S BANK, MOULTON EAUGATE FOR

MR. J. ASHTON.

SITE PLAN

| | |
|---|---|
| 1:200 | SD06-034/4 |
| DEC-06 | B.GILHAM. |

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP
Tel: 01406 424363 Fax: 01406 490702