

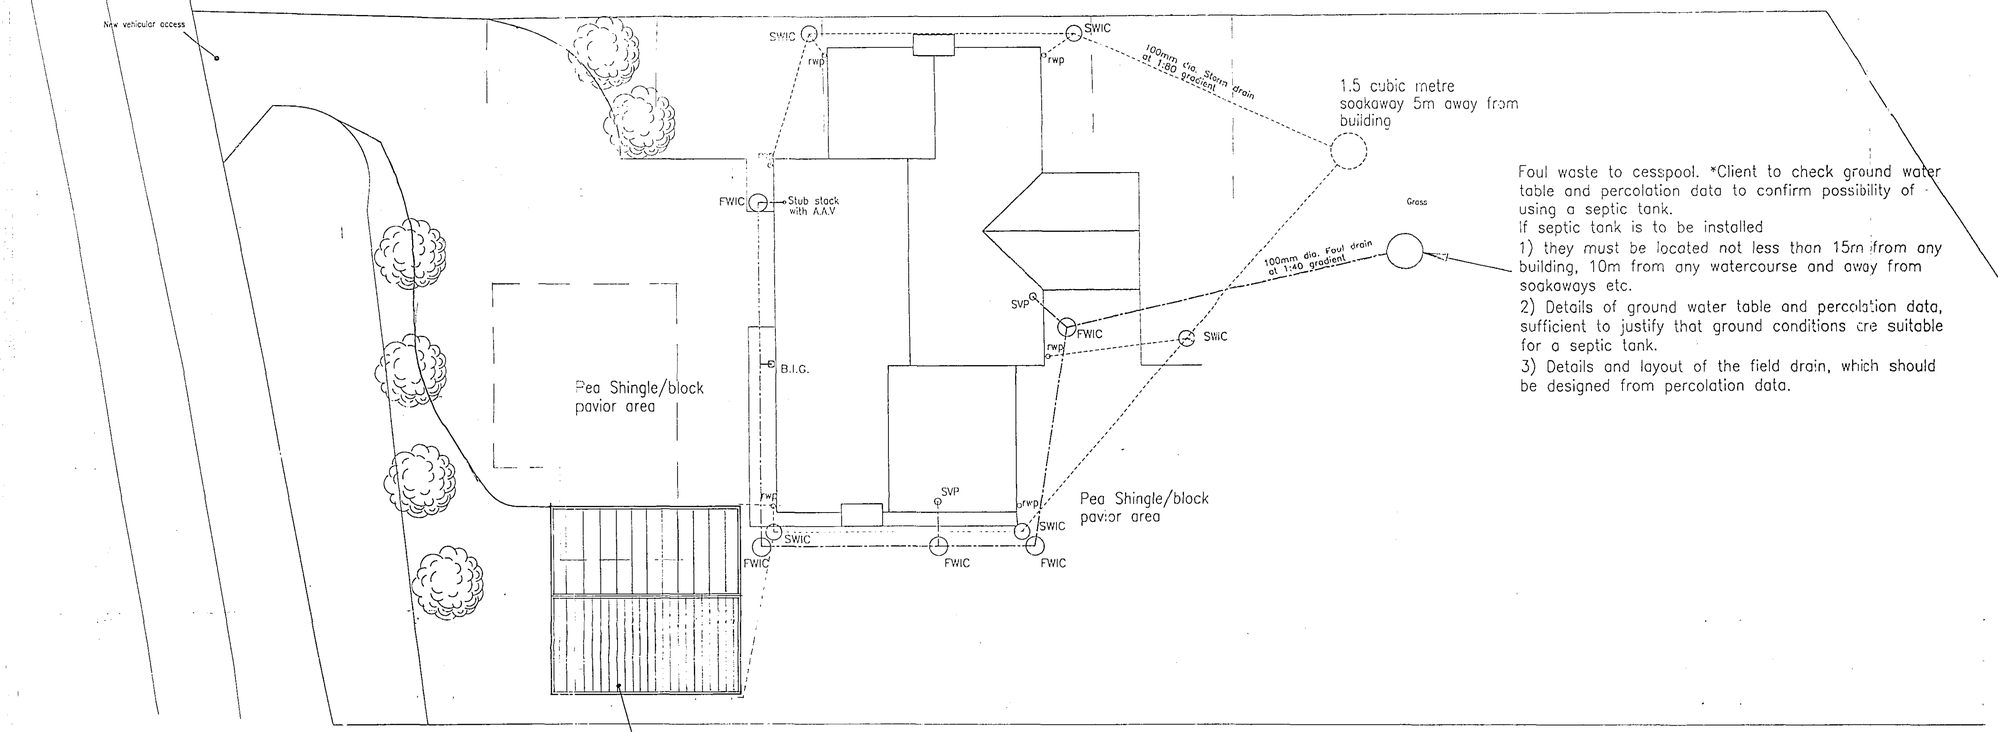


Foul waste to cesspool. *Client to check ground water table and percolation data to confirm possibility of using a septic tank.
If septic tank is to be installed
1) they must be located not less than 15m from any building, 10m from any watercourse and away from soakaways etc.
2) Details of ground water table and percolation data, sufficient to justify that ground conditions are suitable for a septic tank.
3) Details and layout of the field drain, which should be designed from percolation data.


SITE PLAN 1:100

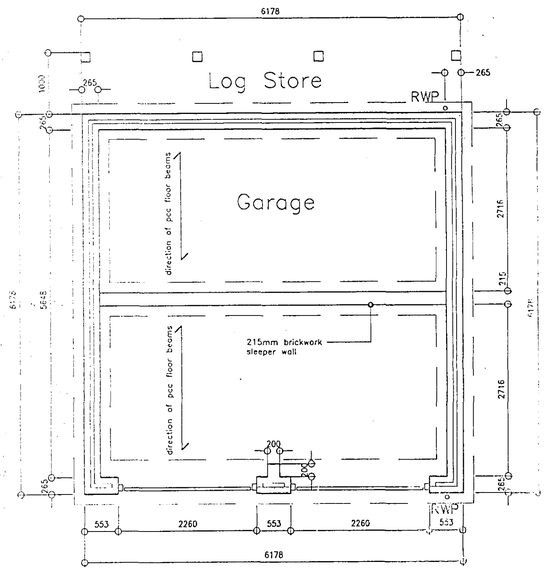


LAYOUT PLAN

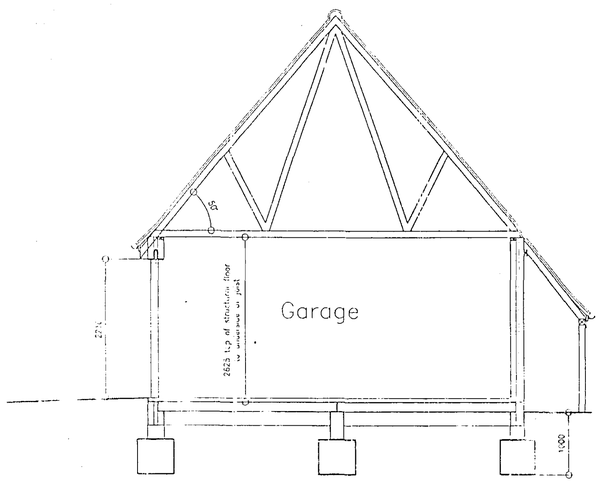


SECTION




FRONT ELEVATION



SIDE ELEVATION



REAR ELEVATION



SIDE ELEVATION

AMENDED PLAN
Ref. A2

16 MAY 2005
Drg: 0401/04

Mrs C Whitsed 1164/05.