

Site construction sequencing should be assessed before the appropriate Visqueen Standard Detail is selected & approved by the Designer

Detail Issued For Guidance Only,
Designer's Approval Required

All laps must be fully sealed.

The design of a Sub-floor Ventilation Layer should be considered to dilute & disperse ground gases


MEMBRANE ABOVE SLAB or BEAM & BLOCK FLOOR

KEY TO MATERIALS :

(Refer to Visqueen Technical Data for full detailed material specification).

- 1) PREFORMED PIPE SLEEVE (SEE PFU-105).
- 2) VISQUEEN GAS BARRIER.
- 3) VISQUEENPRO DOUBLE SIDED JOINTING TAPE (50mmx10m).
- 4) VISQUEEN GR LAP TAPE.
- 5) JUBILEE CLIP.
- 6) VISQUEEN TREADGUARD 1500.
- 7) VISQUEEN VAPOUR BARRIER.
- 8) SMOOTH SAND BLINDING LAYER.

MEMBRANE BELOW SLAB

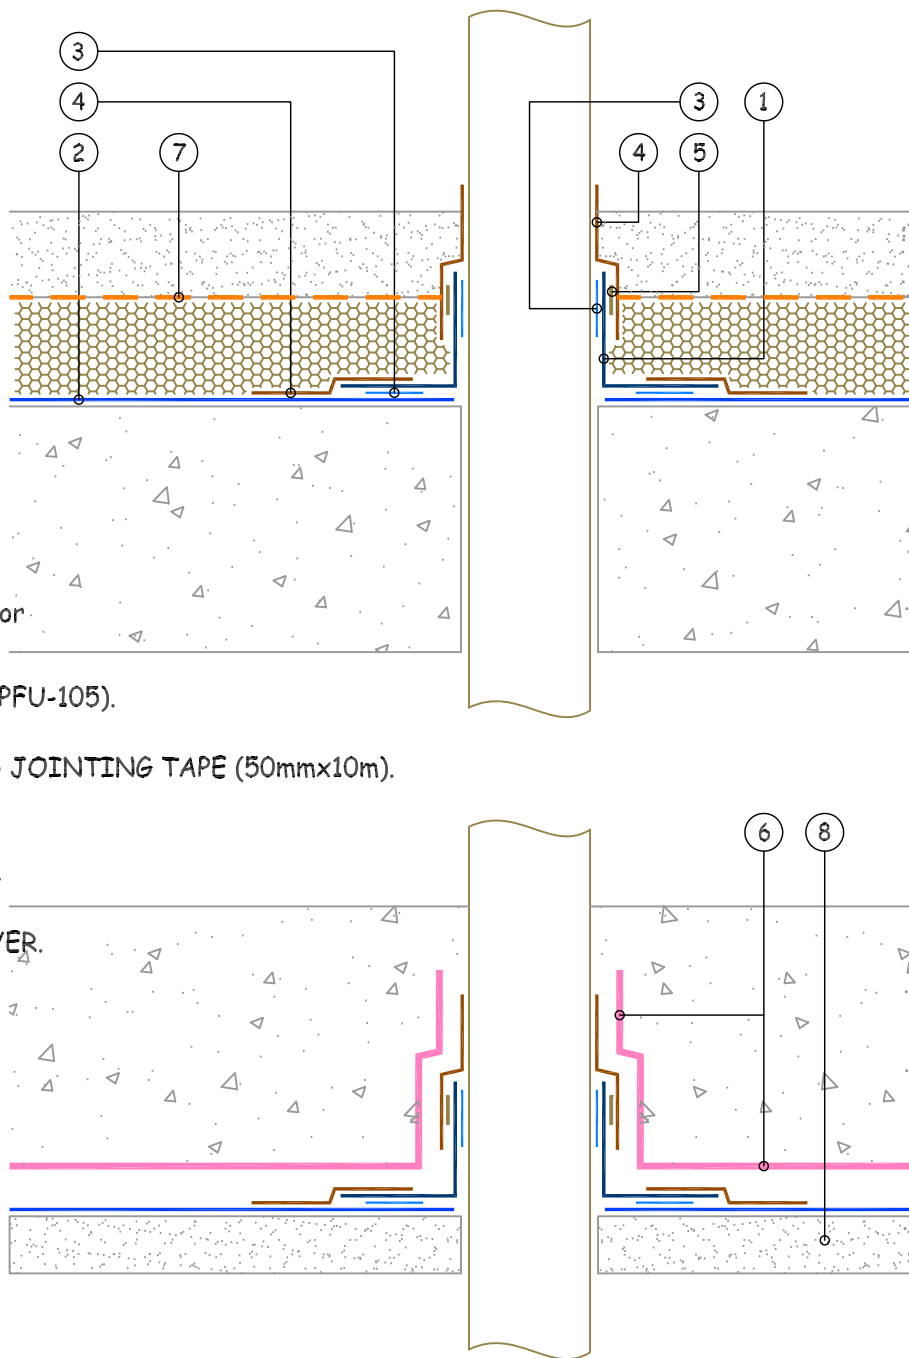

NB: DO NOT SCALE - USE FIGURED DIMENSIONS ONLY.



Visqueen Building Products

Contact Technical Support :

t : 0870 6092084

f : 0870 8508169

e : enquiries@visqueenbuilding.co.uk

www.visqueenbuilding.co.uk

Project: Standard Detail : Pipe Sleeve (Top Hat).

Drawing No.- GB-18.

Date.- 11/11.

Scale.- NTS.

© COPYRIGHT
RESERVED.