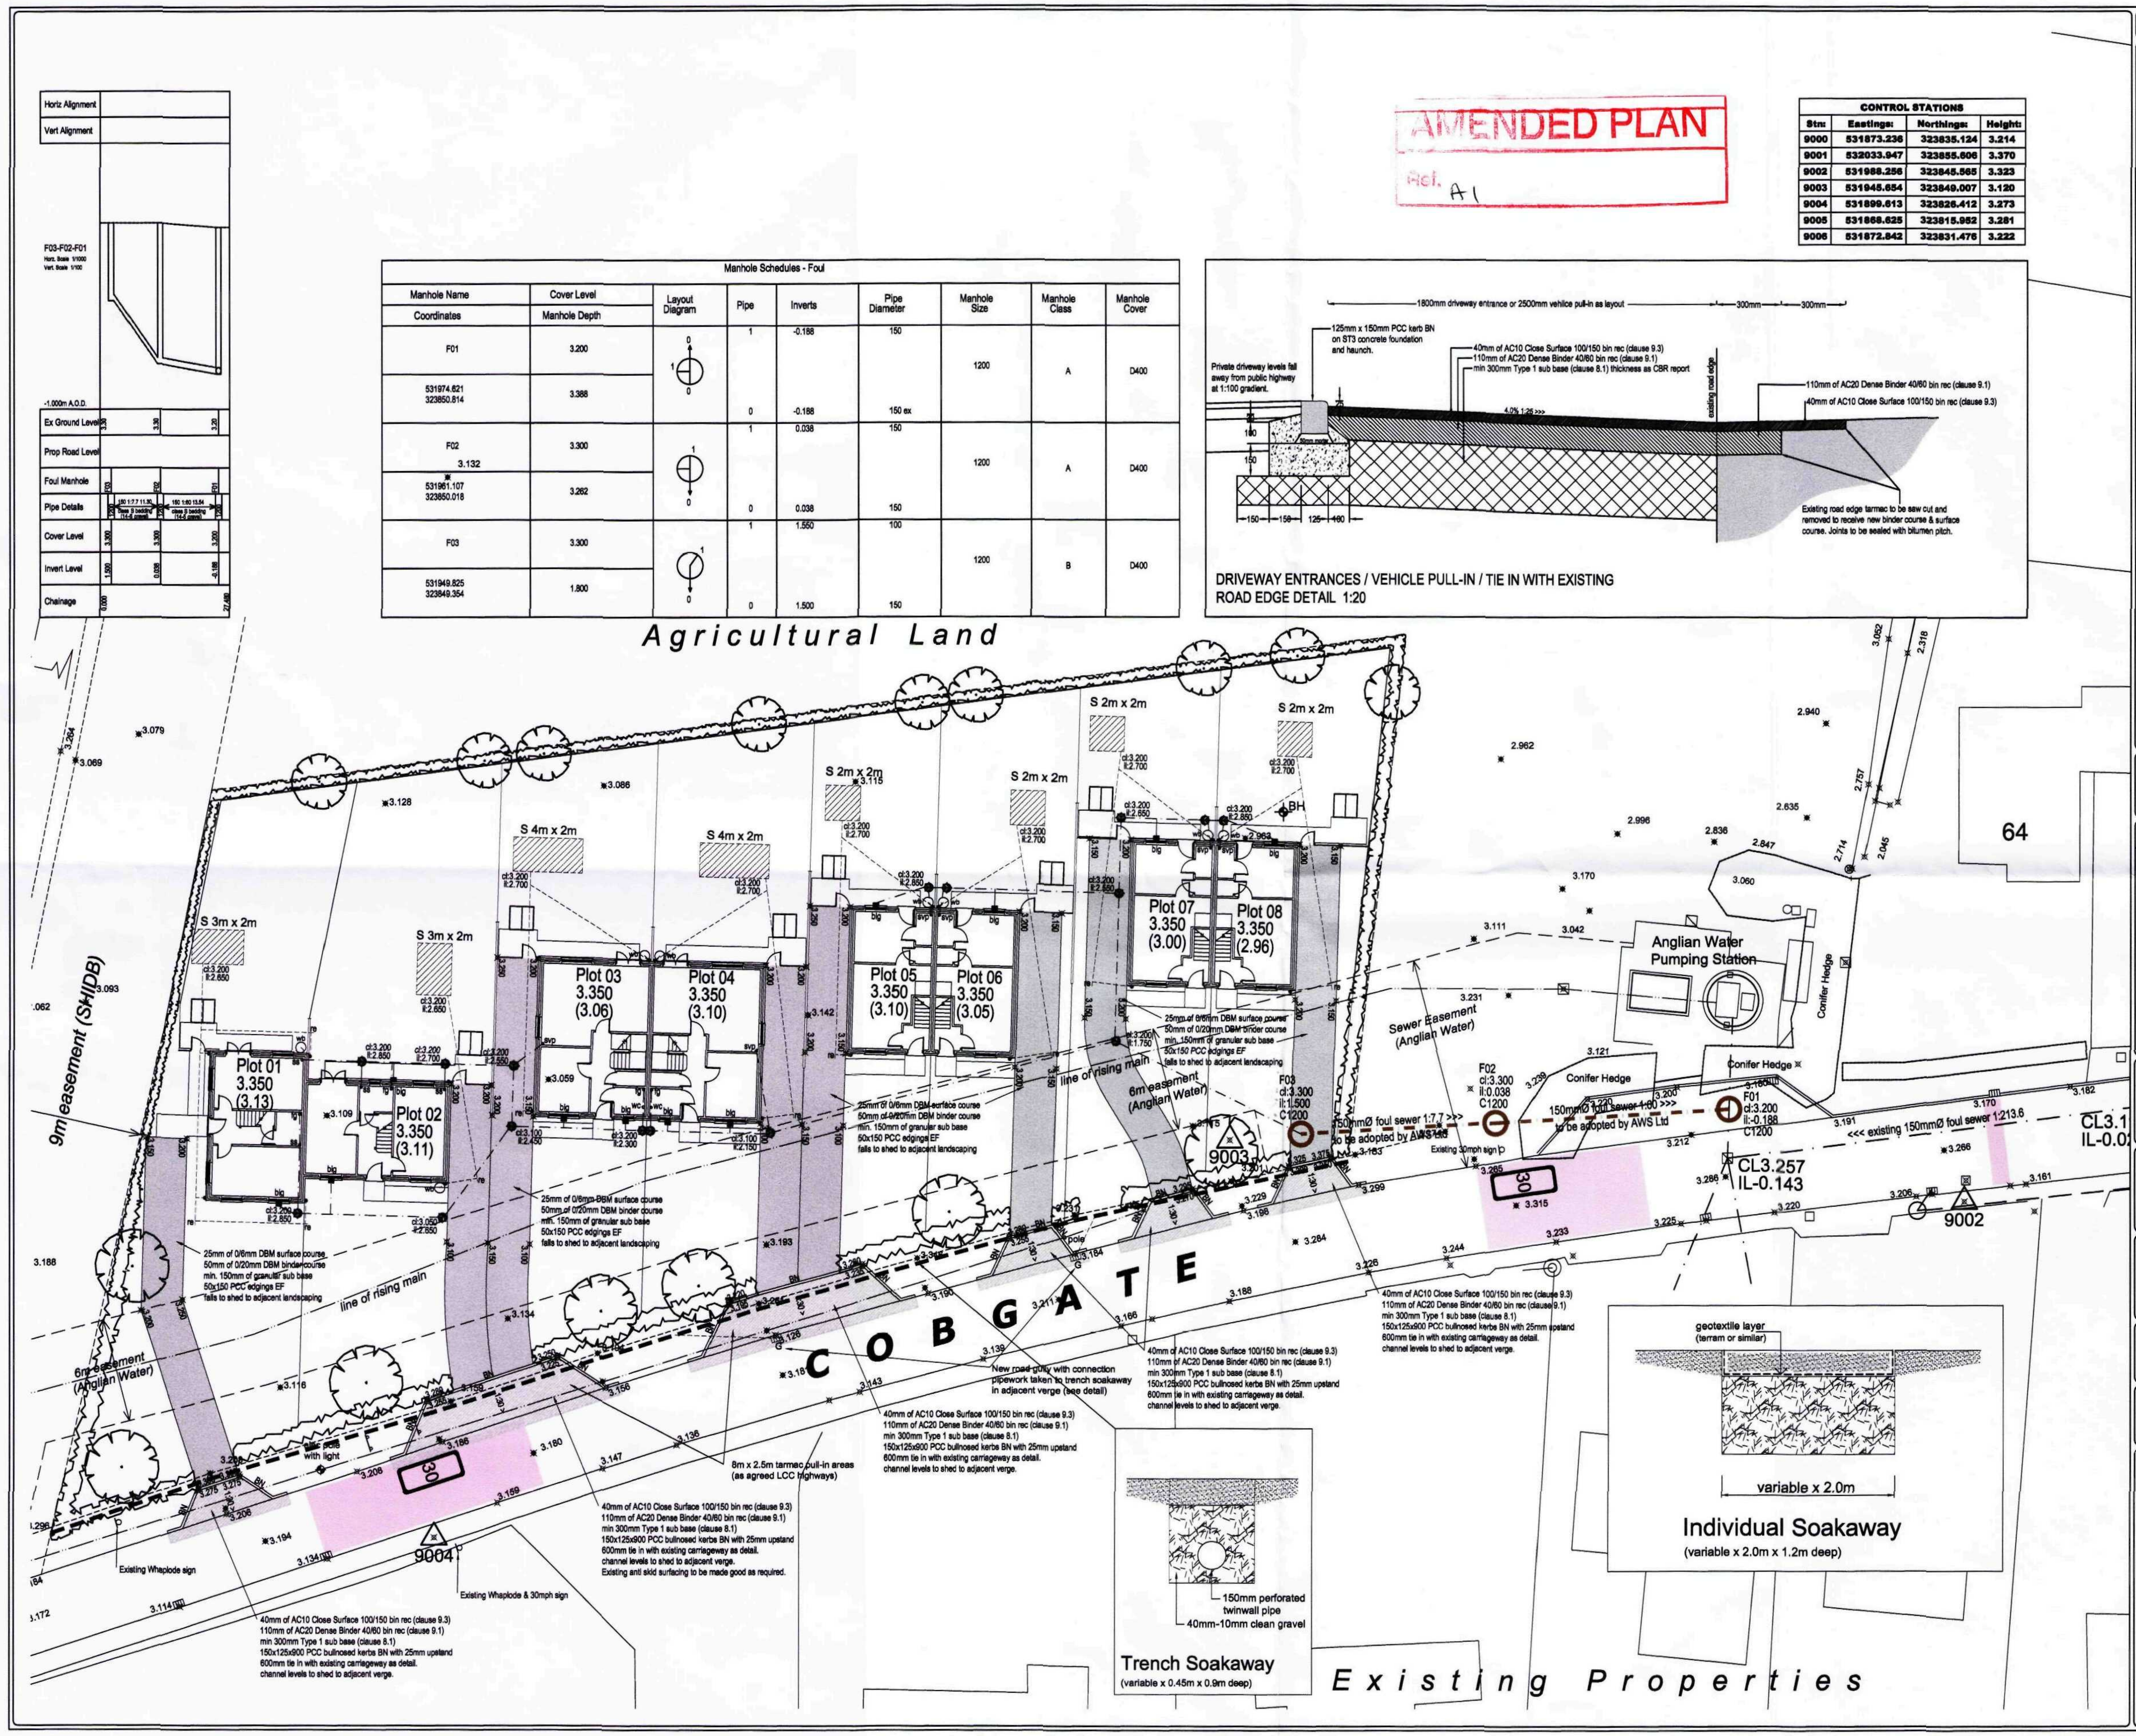

CONTROL STATIONS			
Stn:	Eastings:	Northings:	Height:
9000	531873.236	323835.124	3.214
9001	532033.947	323855.606	3.370
9002	531988.256	323845.565	3.323
9003	531945.654	323849.007	3.120
9004	531899.613	323826.412	3.273
9005	531868.625	323815.952	3.281
9006	531872.842	323831.476	3.222

Manhole Schedules - Foul

Manhole Name / Coordinates	Cover Level / Manhole Depth	Pipe	Inverts	Pipe Diameter	Manhole Size	Manhole Class	Manhole Cover
F01	3.200	1	-0.188	150	1200	A	D400
531974.621 323850.814	3.388	0	-0.188	150 ex			
F02	3.300	1	0.038	150	1200	A	D400
531961.107 323850.018	3.262	0	0.038	150			
F03	3.300	1	1.550	100	1200	B	D400
531949.825 323849.354	1.800	0	1.500	150			

copyright (c) HALL infrastructure DESIGN Ltd.

NOTES:

Domestic Drainage Notes

Plot 05 DENOTES PLOT NUMBER
3.350 DENOTES SUGGESTED FINISHED FLOOR LEVEL
(3.10) DENOTES EXISTING GROUND LEVEL

SURFACE WATER HOUSE DRAIN.

FOUL WATER HOUSE DRAIN.

RAINWATER PIPE ADAPTOR / GULLY HOPPER ON DRIVEWAYS

svp / ss SVP ADAPTOR (SS FITTED WITH AAV)

fg FLOOR GULLY ADAPTOR

wc WC ADAPTOR

big BACK INLET GULLY

re RODDING EYE

POLYPROPYLENE INSPECTION CHAMBER - STORM

POLYPROPYLENE INSPECTION CHAMBER - FOUL

(wb) WATER BUTT SIZED BY THE DEVELOPER

POLYPROPYLENE INSPECTION CHAMBERS TO BE USED UP TO 1.2m DEPTH.

WHERE CHAMBERS ARE SITED WITHIN DRIVEWAYS PROVIDE 150mm C20 CONCRETE SURROUND.

DOMESTIC DRAINAGE TO BE 100mm Ø UPVC OR CLAY LAID NO FLATTER THAN 1:80 GRADIENT.

S variable x 2.0m soakaway (1.2m deep) — soakaways filled with granular material providing 30% free volume and wrapped in terram geotextile

SHDC
Planning & Development
- 8 DEC 2010
Ref: 0586-10

DO NOT SCALE. USE FIGURED DIMENSIONS ONLY. CHECK ON SITE AND ALL DISCREPANCIES TO BE REPORTED TO HALL infrastructure DESIGN Ltd.

AMENDMENTS:

REF.	DESCRIPTION.	DATE.	BY.
A	Amended to clients instruction.	28.05.10	GWH
B	Amended to clients instruction.	28.06.10	GWH
C	F02 - F03 added as adoptable sewer	01.07.10	GWH
D	Long Section & Manhole Schedule added	01.07.10	GWH
E	Line of existing rising main corrected.	31.08.10	GWH
F	Soakaways shown to new gullies on Cobgate as requested by Jon Sharpe.	12.10.10	GWH
G	Soakaways on Cobgate gullies changed to trench type soakaway	13.10.10	GWH

CLIENT:
Stepford Homes Ltd

PROJECT:
Cobgate
Whaplode

TITLE:
Proposed Layout
Long Section & Manhole Schedule

SCALE: 1:250

DATE: May 2010

DRAWING No: 1006/01-G

DRAWN BY: [signature] **CHECKED BY:** [signature]

HALL -infrastructure- DESIGN
Storrs Cottage, The Square,
North Thoresby, Grimsby,
North East Lincs, DN36 5QL
Tel: 01472 259030
email: hall.design@btinternet.com