



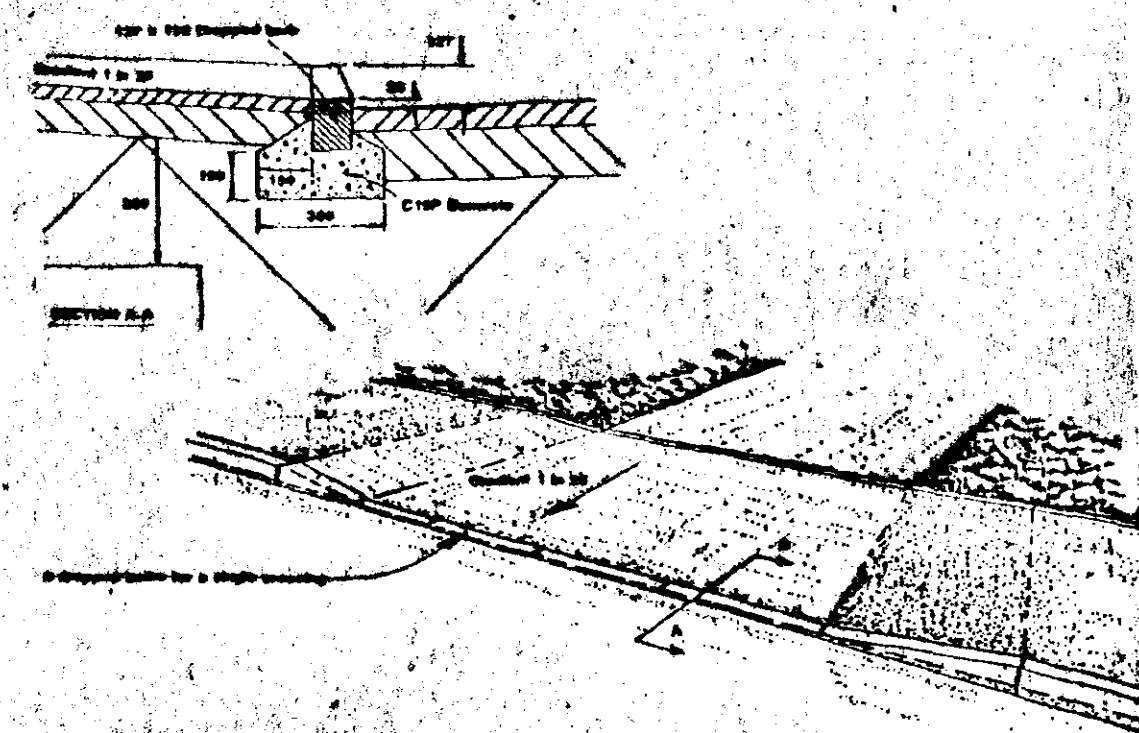

DOMESTIC VEHICLE CROSSING (NEW CONSTRUCTION)

DOMESTIC VEHICLE CROSSING (Flexible Construction)

- Excavate for as necessary and compact the formation prior to laying any foundation material. Provide, lay and compact using vibrating compaction equipment 380mm finished thickness of non-frost susceptible crushed rock, crushed slag or crushed concrete to Type 1 grading. If CBR values are below 2% an approved Geotextile or an extra 150mm of sub-base will be required.
- Provide, lay and compact 50mm finished thickness of 20mm nominal size dense bitumen macadam basecourse to BS: 4987 using 100 pen bitumen binder. Void content 2.8%.
- Provide, lay and compact 25mm finished thickness of 6mm nominal size bitumen macadam wearing course to BS: 4987 using 100 pen bitumen binder. Void content 2.10%.

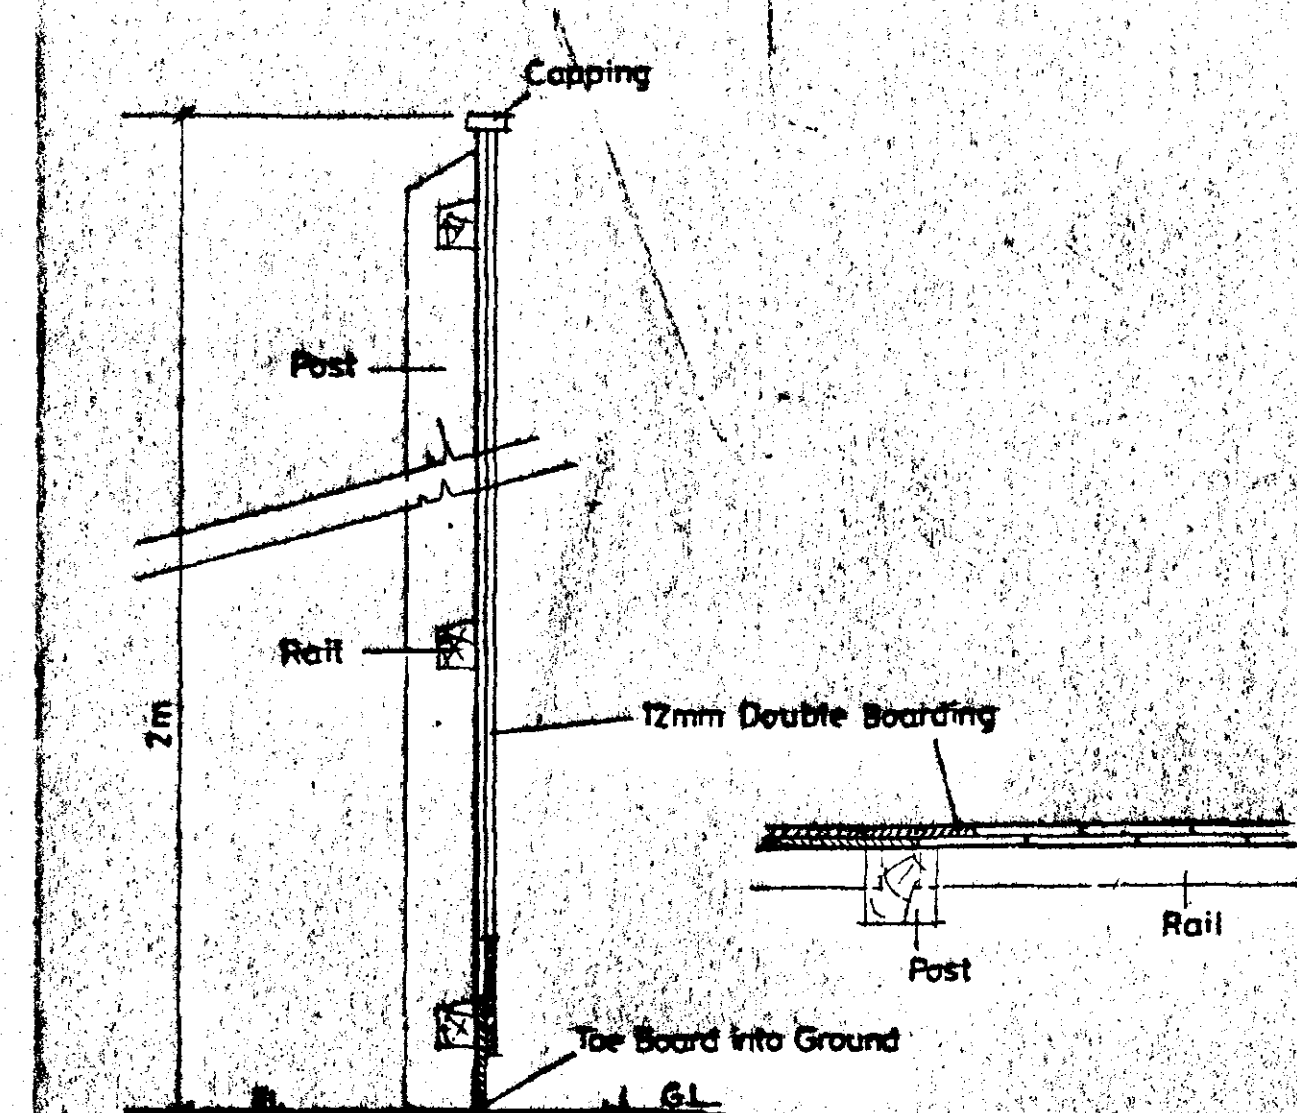

ACOUSTIC FENCE DETAIL

SCALE: 1/10


LANDSCAPING & TREE PLANTING SCHEME

- A EXISTING CONIFER HEDGING
- B EXISTING PRIVET HEDGING TO BE RETAINED AS MUCH AS POSSIBLE & MAINTAINED AT 0.6METRES HIGH.
- C EXISTING HAWTHORN HEDGING TO BE RETAINED AS MUCH AS POSSIBLE & MAINTAINED AT 0.6METRES HIGH.
- D EXISTING HEDGING
- E CONIFERS TO BE REMOVED
- F INFILL HEDGING TO FRONTAGE
- G 2 METRE HIGH ACOUSTIC FENCE
- H SILVER BIRCH (BETULA PENDULA) FEATHERED
- I WHITEBEAM (SORBUS ALBA LUTESCENS) FEATHERED
- K HAWTHORN (CRATAEGUS LAEVIGATA) FEATHERED

All planting to be in accordance with BS 4428:1989 and amendment No.1 (1991)


All trees to be planted with minimum 0.6m plastic mulch mat and to be staked, tied and tubed.

1/3 to 1/4 bag of peat free tree and shrub planting compost to be incorporated into backfill for each tree hole.

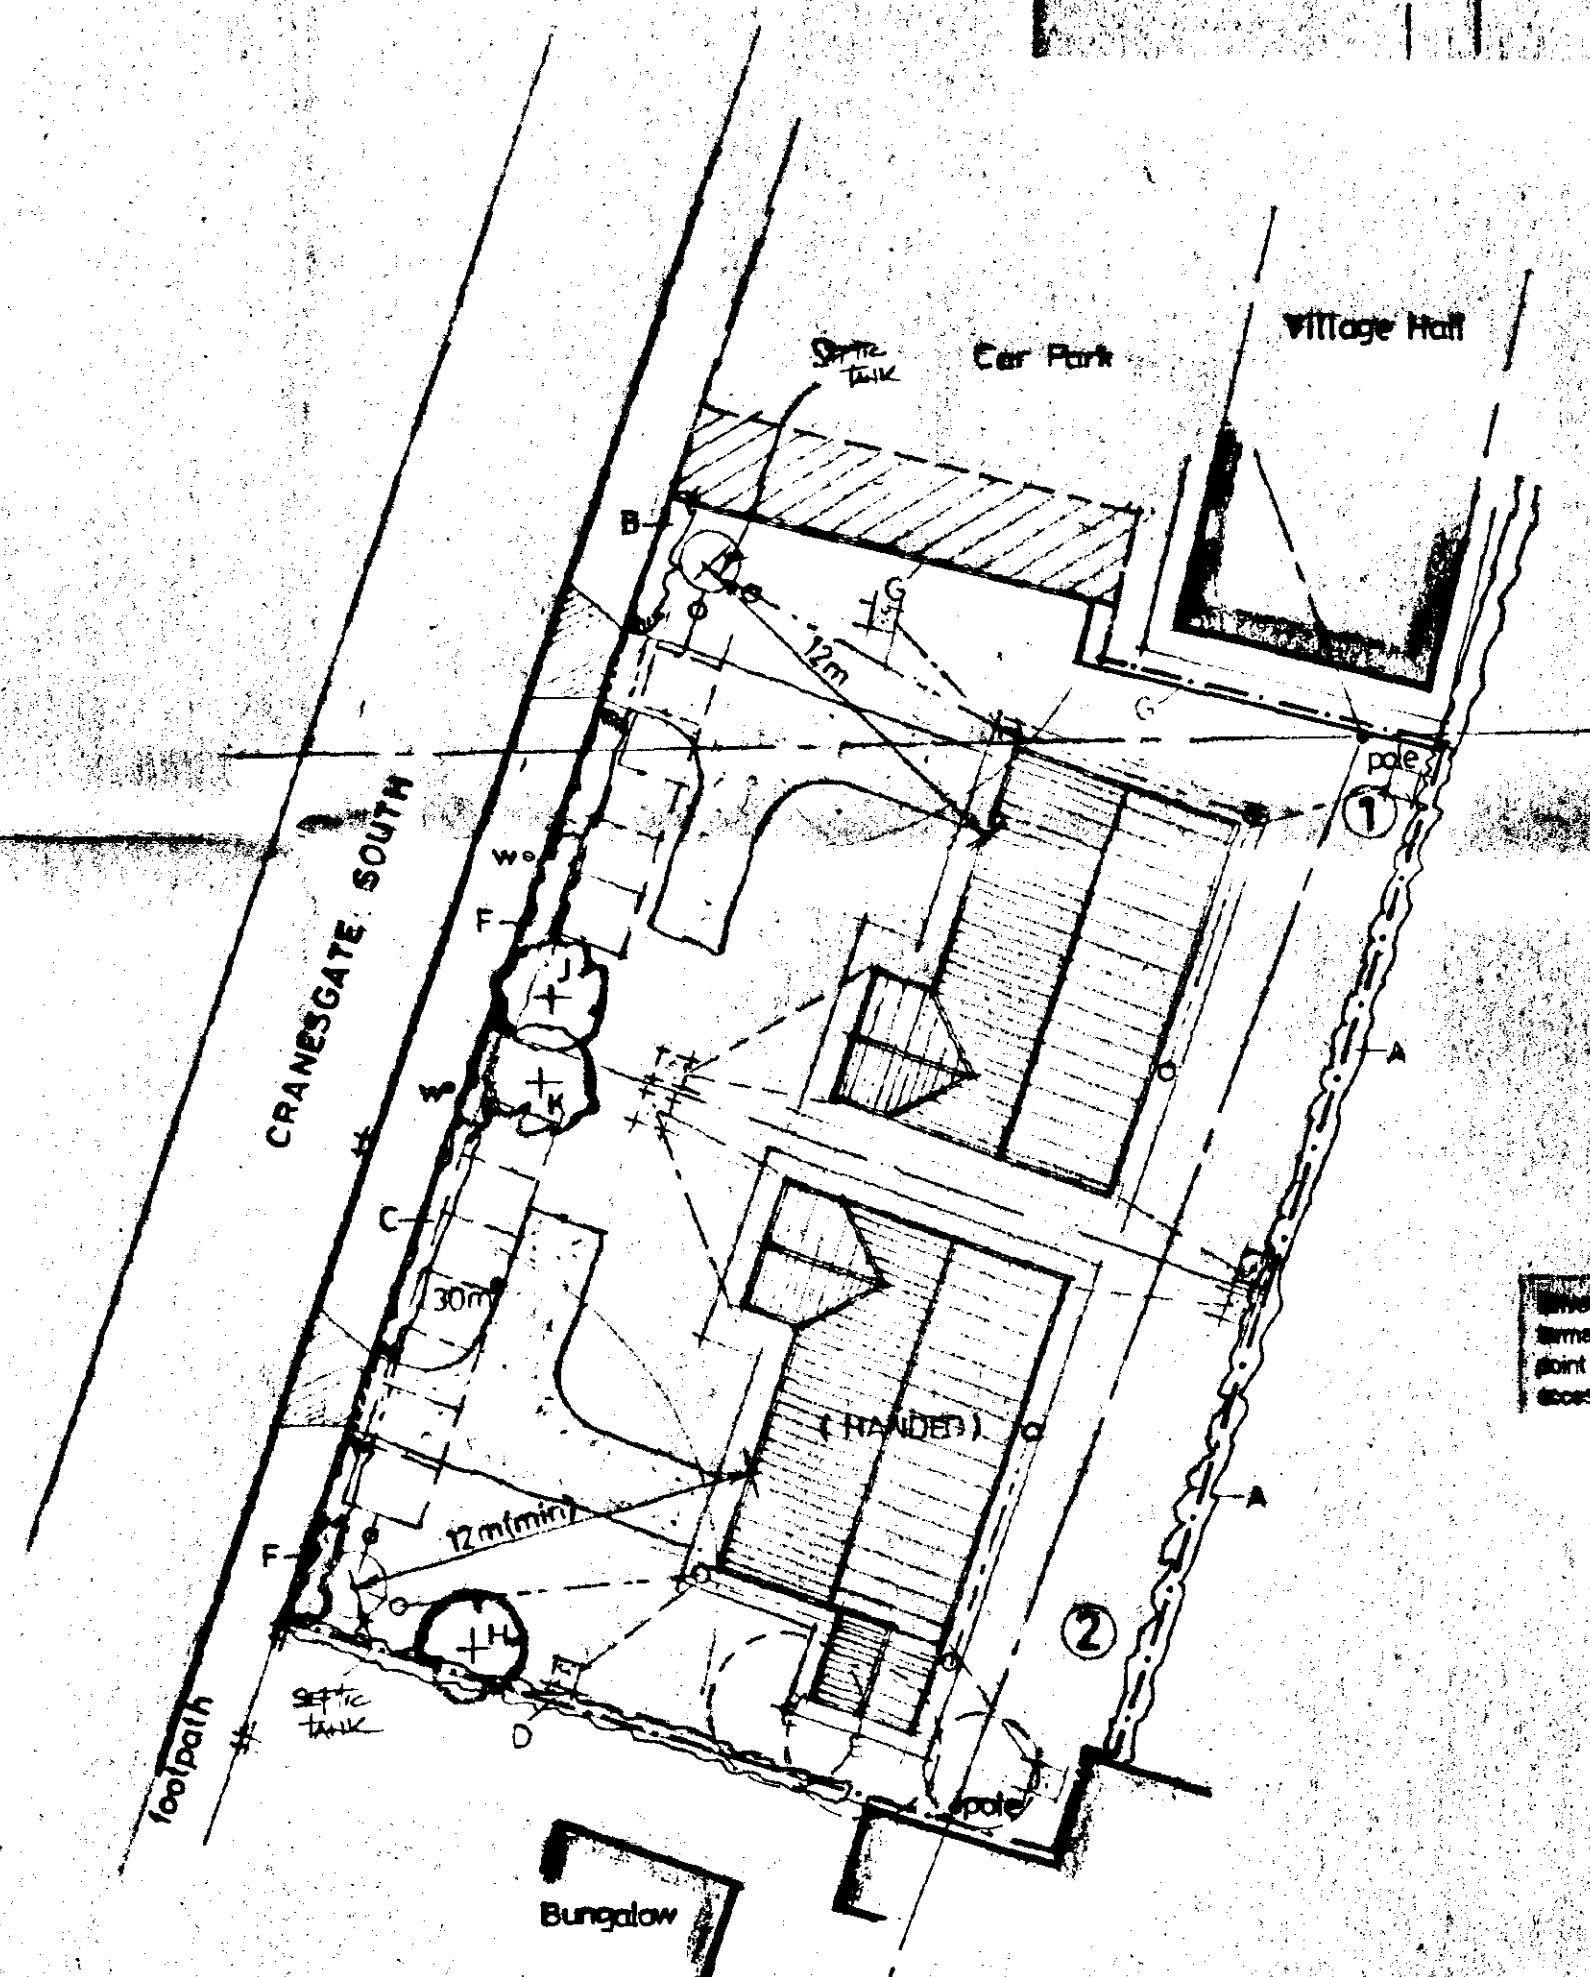

SITE PLAN

1:250

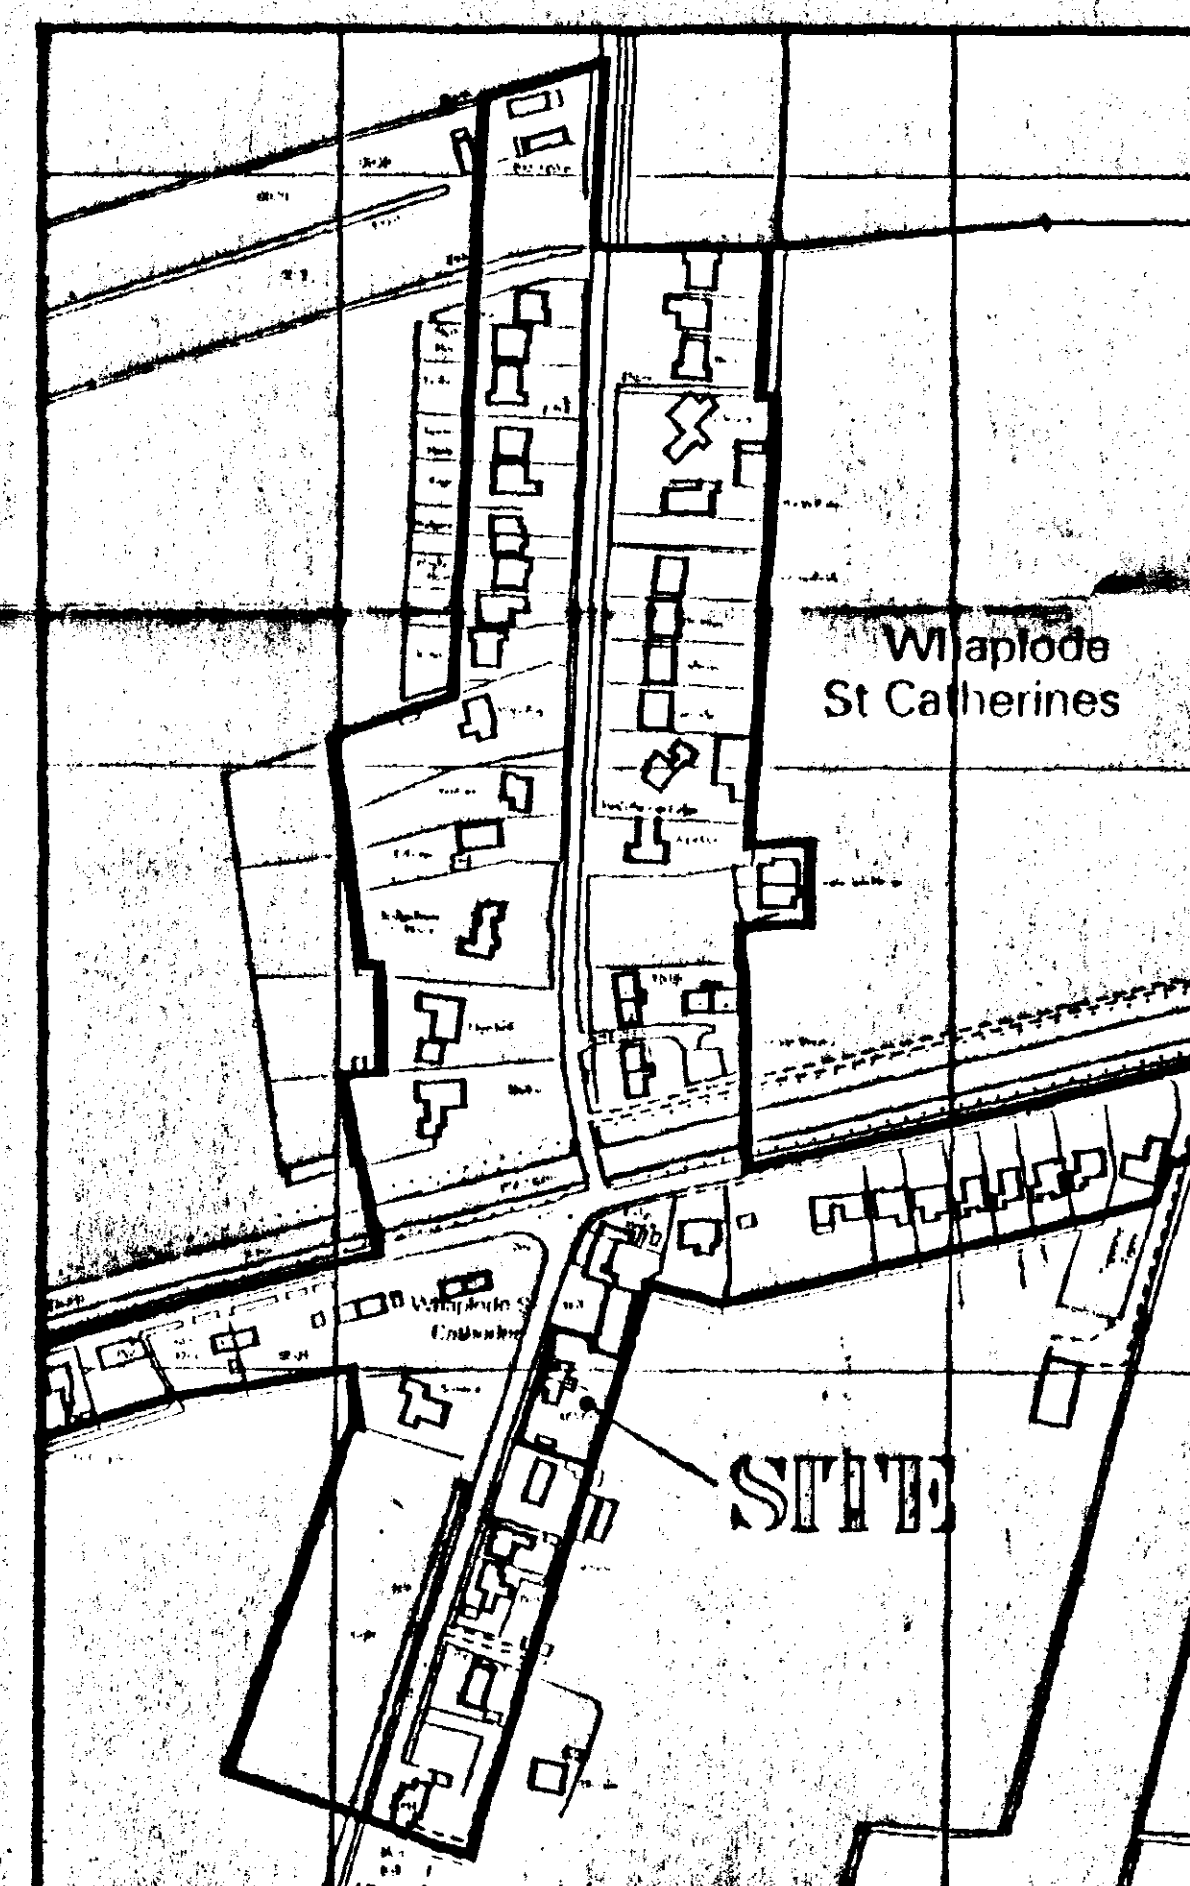

LOCATION PLAN

1:2500

SEPTIC TANK
Connect foul water drains to 800 gallon capacity 'Klargester' type septic tank constructed in accordance with LA requirements. The sub-irrigational drainage system to the septic tank is to be determined by percolation test in accordance with the provisions of clause 15.3.2 of BS:6297, 1983. The applicant is responsible for carrying out the tests and the minimum requirement is 30m² of sub-irrigational drainage or such length as may be determined by the test, whichever is the greater. The Council recommend that septic tanks, cesspools and settlement tanks be sited at a minimum distance of 12 metres (40 feet) from dwellings. Applicants are further advised that during times of inclement weather, the ground water level rises accordingly. It is essential that drainage falls to the septic tank are kept to the minimum say 1 in 80, and the tank, particularly the bottle type, is modified by reducing its neck length by cutting to ensure that both inlet and outlet are maintained above ground water level. Environment Agency do not permit septic tank soakaway systems to be situated within 10 metres of any watercourse or to discharge effluent directly or indirectly into an aquifer.
SHOULD THE RESULTS OF THE PERCOLATION TEST PROVE TO BE UNSATISFACTORY FOR SEPTIC TANK DRAINAGE DUE TO IMPERVIOUS SOIL CONDITIONS SUCH AS CLAY, THEN A CESSPOOL OF 18,000 LITRES (4000 GALLONS) CAPACITY, OR MINI-PACKAGED TREATMENT PLANT MUST BE USED.

AMENDED PLAN

Ref.

HOUSING & PLANNING
2 MAY 2000
Ref: 1066/99

G. 18.0.00 UTILITY - PLANT 2 (Sited on Site Plan)
P. 14.4.00 AMEND - BOUNDARY - VILLAGE HALL CAR PARK
A. 15.2.00 BIRCHES AMENDMENT - DRIVE

G. R. MERCHANT

LENG AMICE, FIWO,
ARCHITECTURAL STRUCTURAL
& LAND DRAINAGE CONSULTANT
TEL: HOLBEACH (01406) 490800

PROJECT:

RESIDENTIAL DEVELOPMENT
CRANESGATE SOUTH
WHAPLODE ST CATHERINES

CLIENT:

C.J. BOLAND

SCALES:

AS INDICATED

DATE:

SEPT 1999

G.R. MERCHANT

DRAWING No:



CJB-WSC-1

REVISIONS:

X.P.C.

DO NOT SCALE FROM THIS DRAWING

This drawing is copyright and may not be altered, traced, photographed or used for any purpose other than that for which it is issued. The General Contractor is to check all dimensions on site and report discrepancies to the Architect. All details shown on this drawing including foundations are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions which may be discovered during construction unless reported to the Architect so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

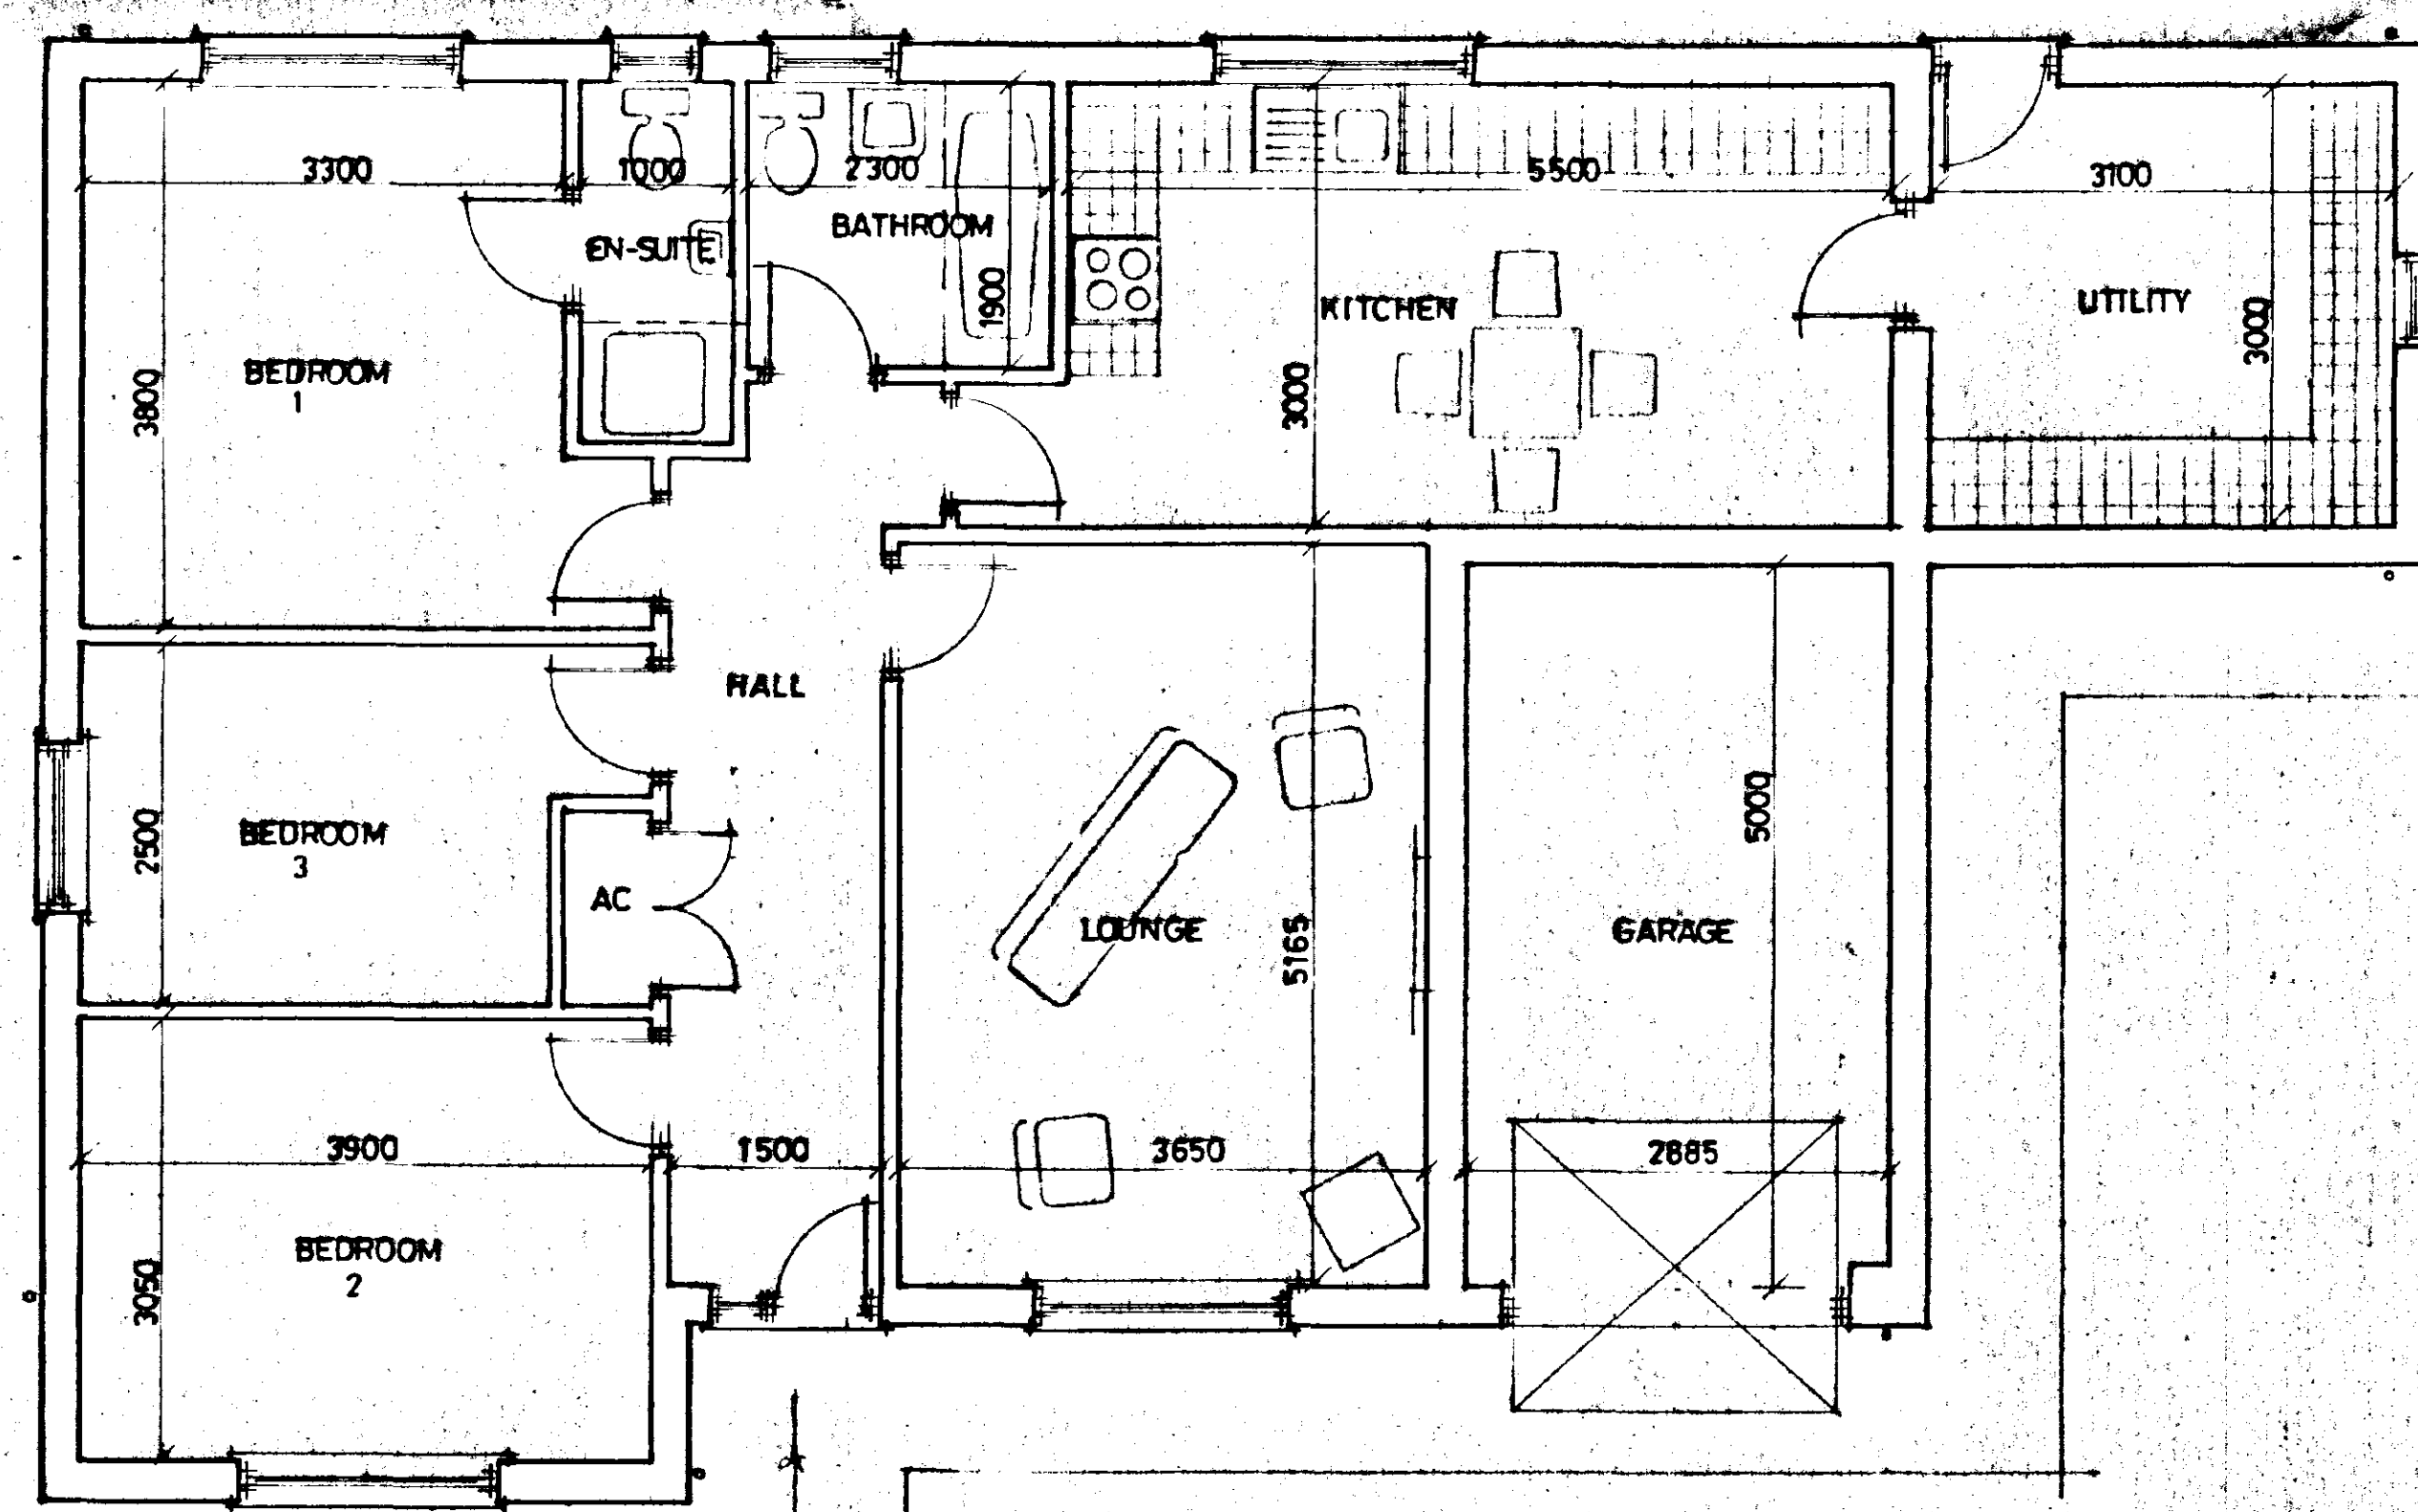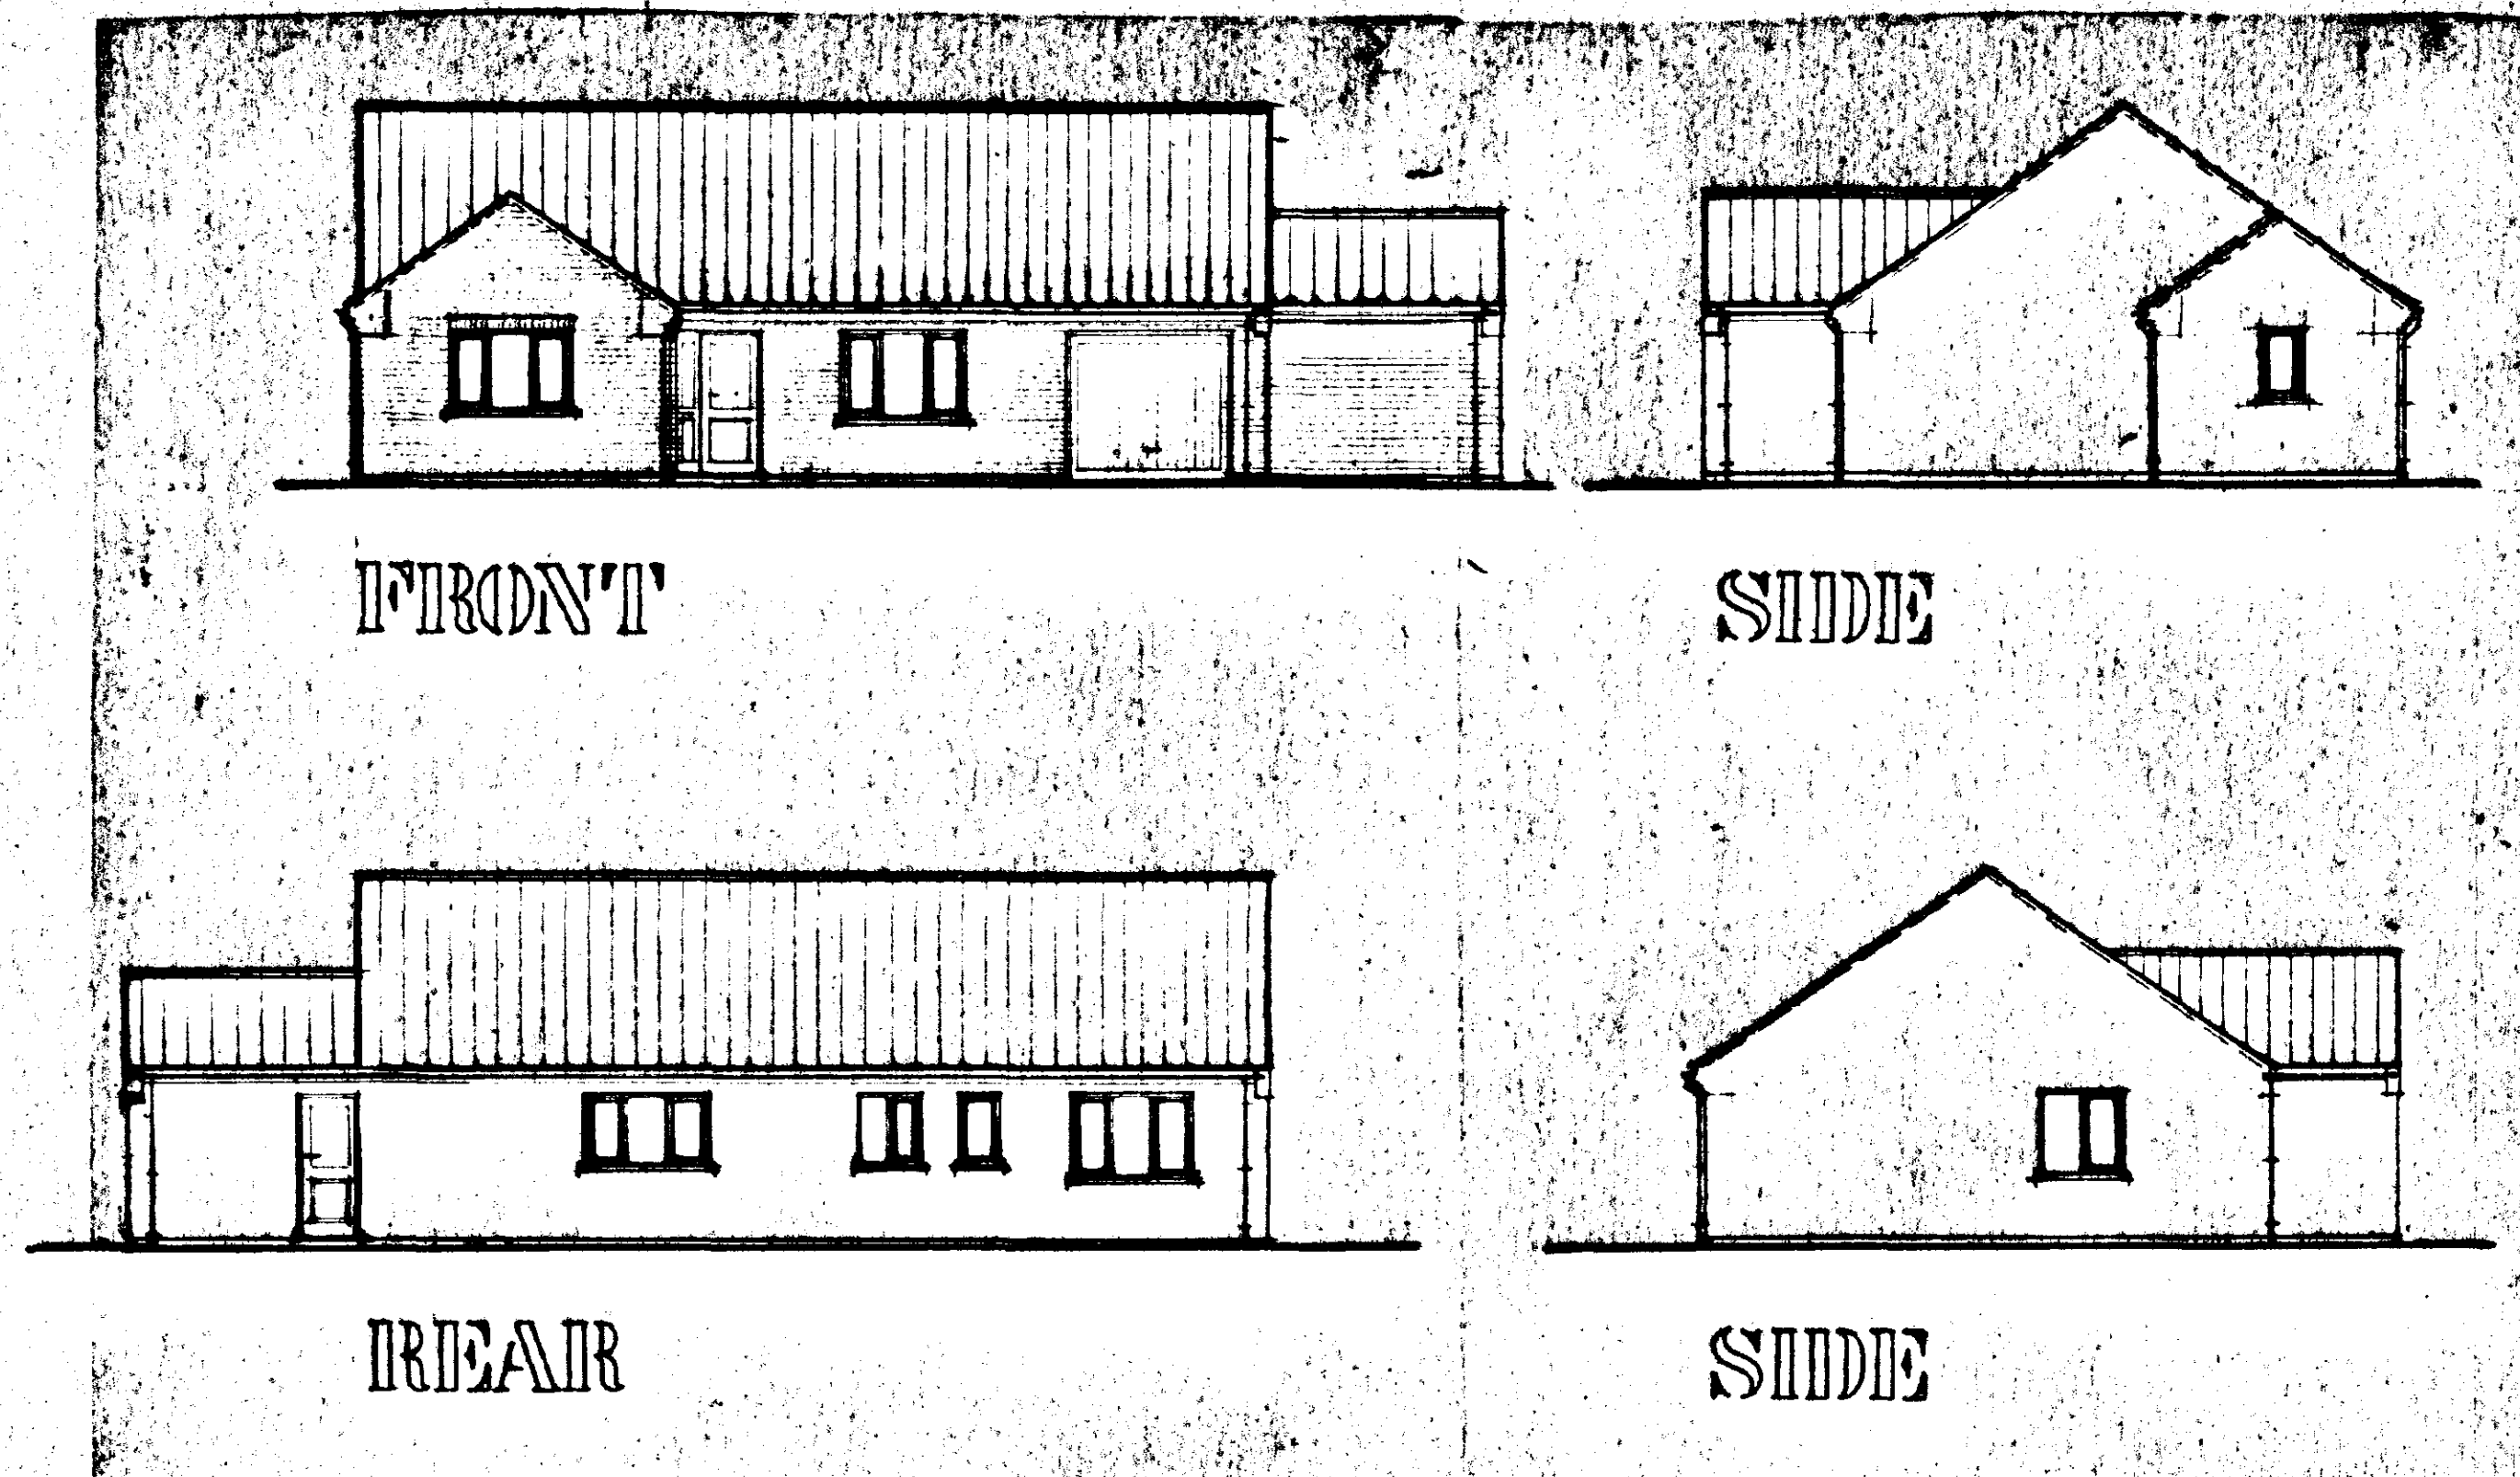

PLAN

DO NOT SCALE FROM THIS DRAWING
 This drawing is copyright and may not be altered, copied, photographed or used for any purpose other than that for which it is issued.
 The General Contractor is to check all dimensions on site and report discrepancies to the Architect.
 All details shown on this drawing including foundations are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions which may be discovered during construction unless reported to the Architect so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

THIS DRAWING TO BE READ IN CONJUNCTION WITH SPECIFICATION & DETAILS INCLUDED ON APPROVED DRAWINGS CJB-WSC1A & CJB-WSC.01B.

PLOT 2

AMENDED PLAN
 Ref.

SOUTH HOLLAND DC
 HOUSING & PLANNING
 23 FEB 2000
 Ref: 106/99

G. R. MERCHANT
 LEUNG AMICE, FIWO,
 ARCHITECTURAL, STRUCTURAL
 & LAND DRAINAGE CONSULTANT
 TEL: HOLBEACH (01406) 490800

PROJECT:
3 BEDROOM BUNGALOW & GARAGE


CLIENT:
C.J. BOLAND

SCALES:
 1/50 1/100


DATE:
 FEB 2000

REVISIONS:


DRAWING No:
CJB-WSC.02

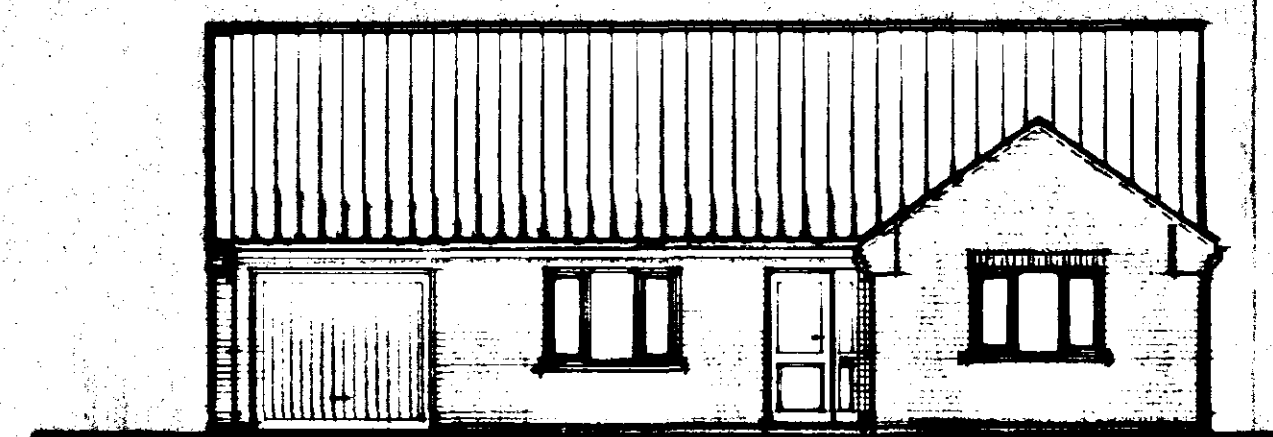


FRONT

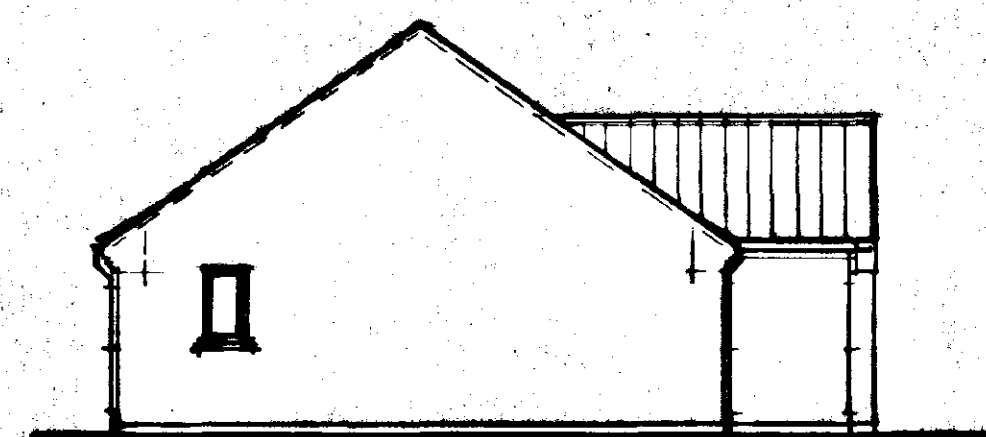


SIDE

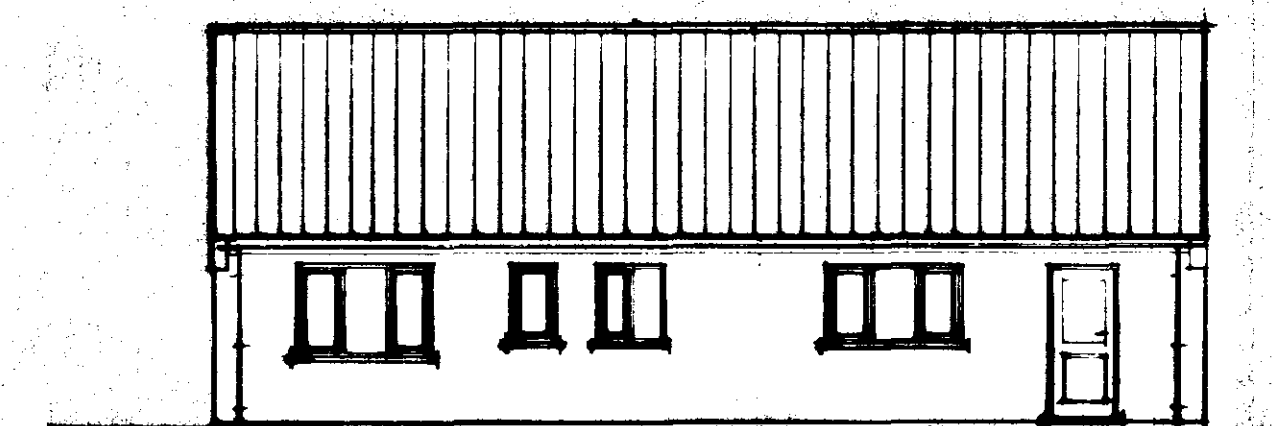

REAR

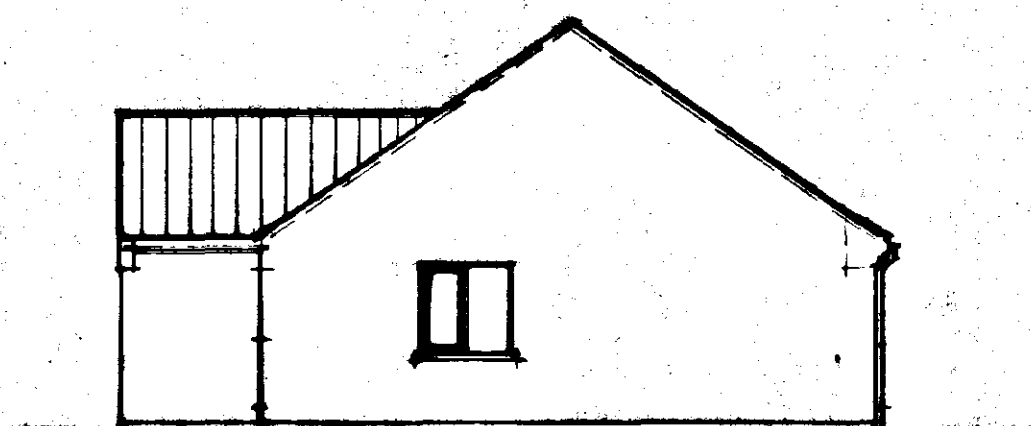

SIDE

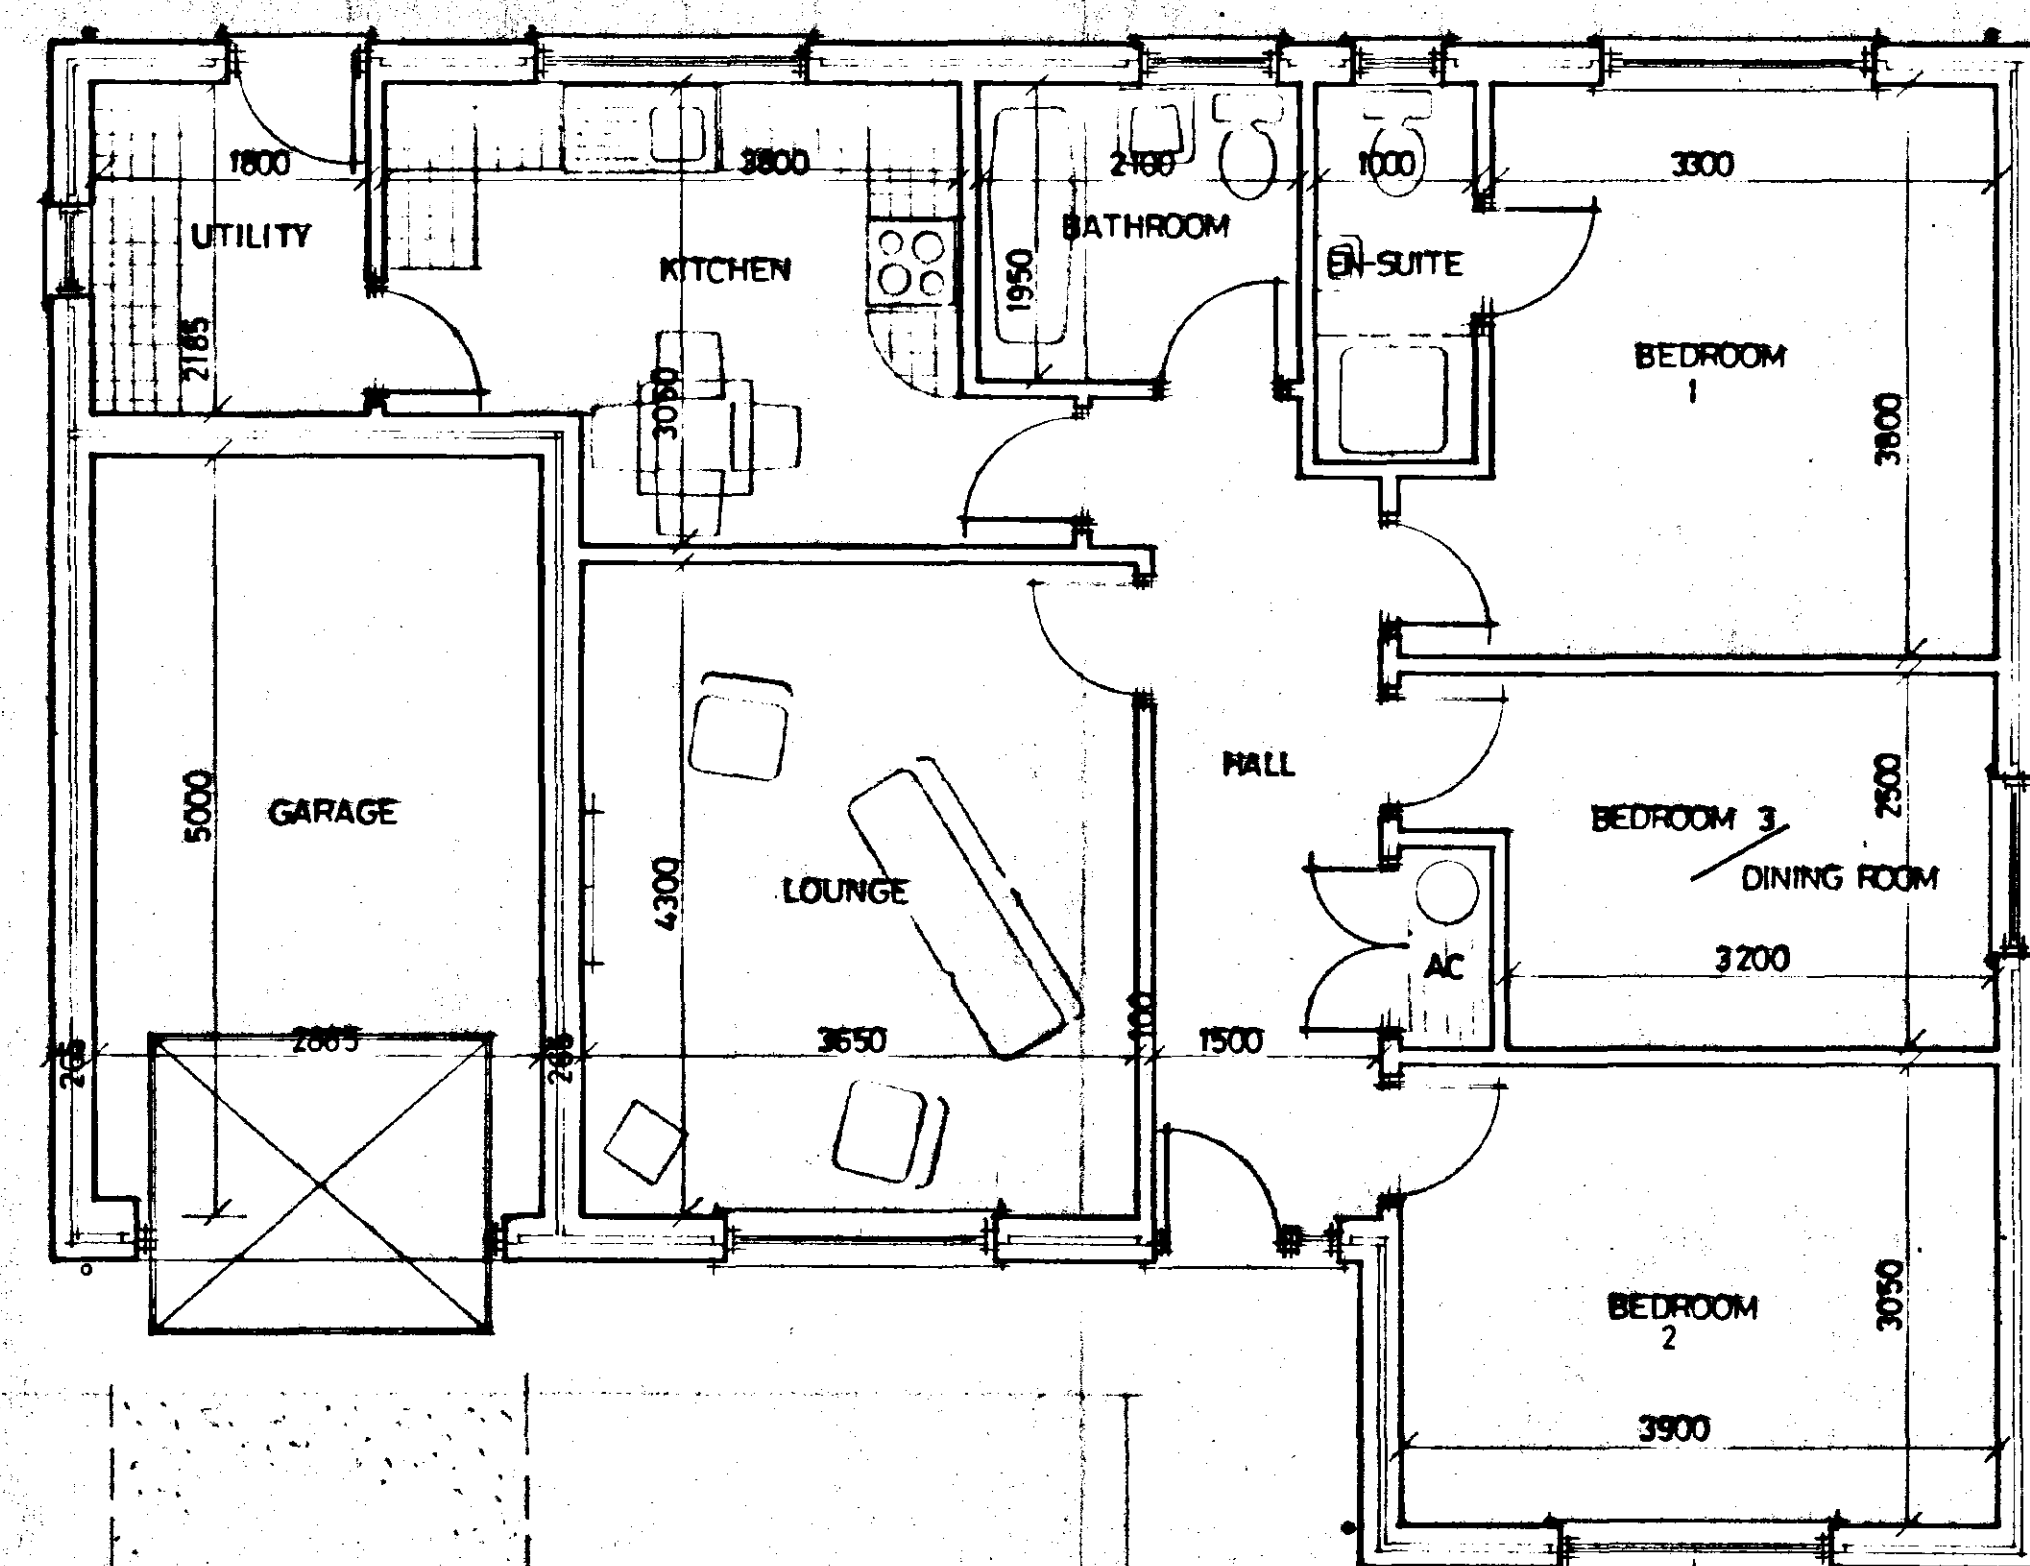

PLAN

DO NOT SCALE FROM THIS DRAWING

This drawing is copyright and may not be altered, traced, photographed or used for any purpose other than that for which it is issued. The General Contractor is to check all dimensions on site and report discrepancies to the Architect. All details shown on this drawing including foundations are based upon typical site conditions related to the area. No responsibility can be assumed for abnormal conditions which may be discovered during construction unless reported to the Architect so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

SOUTH HOLLAND DC
HOUSING & PLANNING
25 OCT 1999
Ref: 1060199

G. R. MERCHANT
LENG AMICE, FIWO,
ARCHITECTURAL, STRUCTURAL
& LAND DRAINAGE CONSULTANT
TEL: HOLBEACH (01406) 490800

PROJECT:

3 BEDROOM BUNGALOW & GARAGE

CLIENT:

C. BOLAND

SCALES:

1/10 1/100

DATE:

SEPT 1999

G. R. MERCHANT

DRAWING No.:
CJB-WSC-01

REVISIONS: