



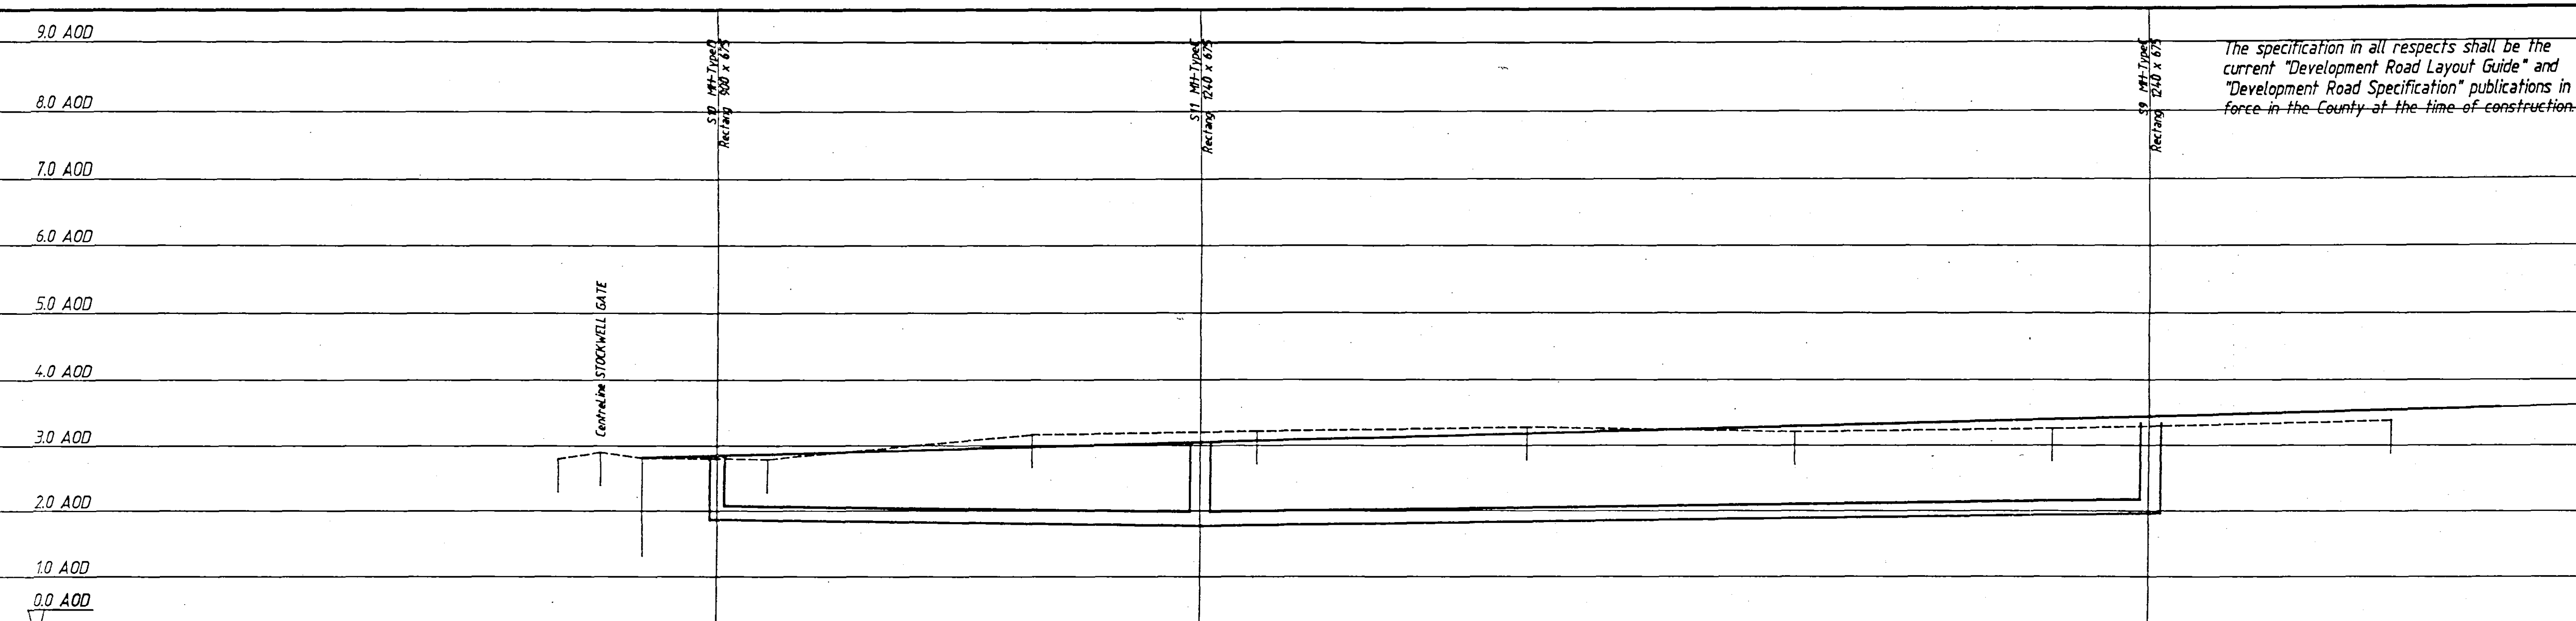

The specification in all respects shall be the current "Development Road Layout Guide" and "Development Road Specification" publications in force in the County at the time of construction.

STORM SEWERS		COVER LEVEL & PIPE NUMBER	1+78	1+82
STORM SEWERS		PIPE BEDDING	ConcSmd	ConcSmd
STORM SEWERS		PIPE SIZE, MATERIAL & STRENGTH	CircPipe 225 # ClayWare ExtraStr	CircPipe 225 # ClayWare ExtraStr
STORM SEWERS		INVERT LEVEL, PIPE LENGTH & GRADIENT	1+78 L=30.0 1/300	1+82 L=60.0 1/300
FOUL SEWERS		COVER LEVEL & PIPE NUMBER	1+78	1+82
FOUL SEWERS		PIPE BEDDING		
FOUL SEWERS		PIPE SIZE, MATERIAL & STRENGTH		
FOUL SEWERS		INVERT LEVEL, PIPE LENGTH & GRADIENT		

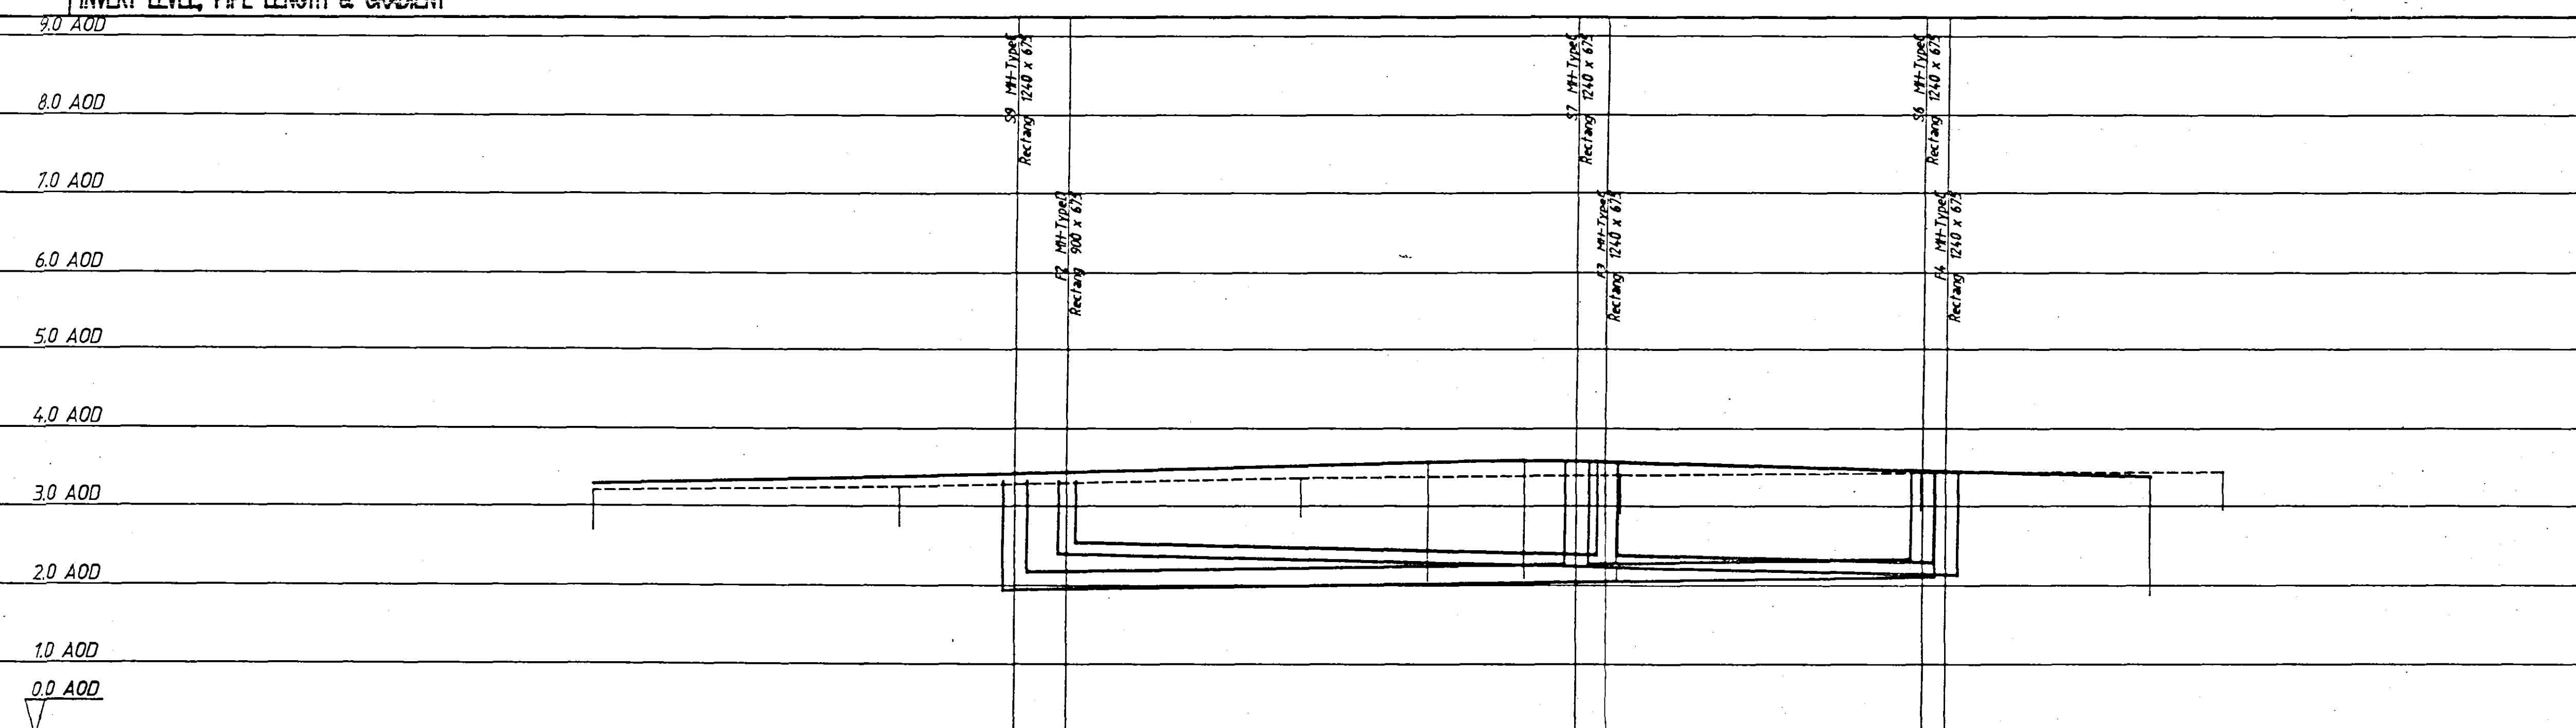

G	
F	
E	
D	19/02/03 Foul sewers revised.
C	20/09/93 Bedding to PN 5.01 & 5.02 revised
B	17/07/93 Foul sewers amended.
A	15/03/93 Foul & storm sewers redesigned.

Revisions
Project
STOCKWELL GATE, WHAPLODE, LINCOLNSHIRE

Title
SEWER LONGITUDINAL SECTIONS SHEET 2 OF 3

Client
ASHWOOD HOMES

Architect
18 SEP 2003

STORM SEWERS		COVER LEVEL & PIPE NUMBER	1+78	1+82
STORM SEWERS		PIPE BEDDING	ConcSmd	Class B
STORM SEWERS		PIPE SIZE, MATERIAL & STRENGTH	CircPipe 225 # ClayWare ExtraStr	CircPipe 225 # ClayWare ExtraStr
STORM SEWERS		INVERT LEVEL, PIPE LENGTH & GRADIENT	1+78 L=30.0 1/300	1+82 L=30.0 1/300
FOUL SEWERS		COVER LEVEL & PIPE NUMBER	1+78	1+82
FOUL SEWERS		PIPE BEDDING	ConcSmd	ConcSmd
FOUL SEWERS		PIPE SIZE, MATERIAL & STRENGTH	CircPipe 150 # ClayWare ExtraStr	CircPipe 150 # ClayWare ExtraStr
FOUL SEWERS		INVERT LEVEL, PIPE LENGTH & GRADIENT	1+78 L=30.0 1/100	1+82 L=30.0 1/120

Scales: 1/200 HZ, 1/50 VT Date: February 1993
Drawn: GDS Checked: Reinf. Checked:

RLT Engineering Consultants Ltd.
CONSULTING STRUCTURAL & CIVIL ENGINEERS
RLT House 5 Oxford Road Colchester Essex CO3 3HN
Telephone: 0206 768655 Fax: 0206 768656
Drawing No. 9112/04/08 Revision D